

COOLING CAPACITY: 23,800 - 52,500 BTU/H
 HEATING CAPACITY: 23,800 - 52,000 BTU/H

**HIGH-EFFICIENCY,
 COMFORTNET-COMPATIBLE,
 SPLIT SYSTEM HEAT PUMP
 UP TO 21 SEER**



Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	20
Performance Data	
Standard Mode	22
Boost Mode	24
Sound Power Levels	25
AHRI Ratings	26
Dimensions	35
Wiring Diagram.....	36
Accessories	39

Standard Features

- Variable-speed swing and scroll compressors
- High-density foam compressor sound blanket
- ComfortNet™ Communications System compatible
- Amana control algorithmic logic
- In communicating mode, only two low-voltage wires to outdoor unit required
- Diagnostic indicator lights, seven-segment LED display, and fault code storage
- Field-selectable boost mode increases compressor speed during unusually high loads
- Quiet ECM outdoor fan motor
- Fully charged for 15' of tubing length
- Field-installed bi-flow filter drier
- Coil and ambient temperature sensors
- Suction pressure transducer
- Sweat connection service valves with easy access to gauge ports
- AHRI Certified; ETL Listed

Cabinet Features

- Heavy-gauge galvanized-steel cabinet with grille-style sound control top design
- Custom two-tone gray powder-paint finish
- 500-hour salt-spray tested
- Wire fan discharge grille
- Steel louver coil guard
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets the 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)







Proper sizing and installation of equipment is critical to achieving optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.



* Complete warranty details available from your local dealer or at www.amana-hac.com. To receive the Lifetime Unit Replacement Limited Warranty (good for as long as you own your home) and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Additional requirements for annual maintenance are required for the Unit Replacement Limited Warranty. Online registration and some of the additional requirements are not required in California or Quebec.

	A	V	Z	C	20	036	1	AA		
	1	2	3	4	5,6	7,8,9	10	11,12		
Brand								Engineering *		
A Amana® Brand								Major/ Minor Revisions		
								* Not used for order or inventory control		
Product Category								Electrical		
S Split System								1 - 208/230 V, 1 Phase, 60 Hz		
V Inverter Split System										
Unit Type								Capacity		
X Condenser R-410A								024 2 Tons	048 4 Tons	
Z Heat Pump R-410A								036 3 Tons	060 5 Tons	
Communication Feature								Efficiency		
C ComfortNet 4-wire communications ready								16 16 SEER	18 18 SEER	20 20 SEER

	AVZC20 0241A*	AVZC20 0361A*	AVZC20 0481A*	AVZC20 0601A*
CAPACITIES AND RATINGS				
Max. Cooling (BTU/h)	23,800	35,400	46,500	52,500
Max. Heating (BTU/h)	23,800	35,000	46,000	52,000
COMPRESSOR				
Type	Swing	Swing	Swing	Scroll
RLA	12.70	27.30	27.30	28.60
CONDENSER FAN MOTOR				
Horsepower	1/2	1/2	1/2	1/2
FLA	2.5	2.5	2.5	2.5
REFRIGERATION SYSTEM				
Refrigerant Line Size				
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	7/8"	1 1/8"	1 1/8"
Refrigerant Connection Size				
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	7/8"	7/8"	7/8"
Valve Connection Type	Ball Valve	Ball Valve	Ball Valve	Ball Valve
Refrigerant Charge	165	272	272	242
Superheat at Service Valve	7-9°F	7-9°F	7-9°F	7-9°F
Subcooling at Service Valve	7-9°F	7-9°F	7-9°F	7-9°F
ELECTRICAL DATA				
Volts-Phase (60 Hz)	208-230/1	208-230/1	208-230/1	208-230/1
Minimum Circuit Ampacity ²	15.2	29.8	29.8	31.1
Max. Overcurrent Protection ³	20	30	30	35
Min / Max Volts	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)	220	285	285	345
SHIP WEIGHT (LBS)	240	305	305	365
ENERGY STAR® CERTIFIED [^]				

^ ENERGY STAR NOTES

- Products that are recognized as the Most Efficient of ENERGY STAR® in 2017 prevent greenhouse gas emissions by meeting rigorous energy efficiency performance levels set by the U.S. Environmental Protection Agency.
- Proper sizing and installation of equipment is critical to achieving optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.
- The www.energystar.gov website provides up-to-date system combinations certified to meet ENERGY STAR requirements. See Page 26 for all ENERGY STAR® certified combinations as of this document's revision date.

¹ Tested and rated in accordance with AHRI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 3/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

IDB*		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
620	MBh	20.5	21.3	23.3	-	20.1	20.8	22.8	-	19.6	20.3	22.2	-	19.1	19.8	21.7	-	18.2	18.8	20.6	-	16.8	17.4	19.1	-
	S/T	0.68	0.57	0.39	-	0.71	0.59	0.41	-	0.72	0.60	0.42	-	0.75	0.62	0.43	-	0.78	0.65	0.45	-	0.78	0.65	0.45	-
	ΔT	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	19	17	13	-
	KW	1.31	1.34	1.38	-	1.42	1.45	1.50	-	1.51	1.55	1.60	-	1.60	1.64	1.69	-	1.67	1.71	1.77	-	1.73	1.77	1.84	-
	Amps	5.5	5.6	5.8	-	5.9	6.1	6.3	-	6.5	6.6	6.9	-	6.9	7.1	7.4	-	7.4	7.6	7.8	-	7.8	8.0	8.3	-
	Hi PR	215	232	245	-	242	260	275	-	275	296	312	-	313	337	356	-	352	379	400	-	389	419	442	-
Lo PR	101	108	118	-	107	114	125	-	111	119	129	-	117	125	136	-	123	130	142	-	127	135	147	-	
70	MBh	22.3	23.1	25.3	-	21.7	22.5	24.7	-	21.2	22.0	24.1	-	20.7	21.5	23.5	-	19.7	20.4	22.3	-	18.2	18.9	20.7	-
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.65	0.45	-	0.80	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	20	17	13	-	20	18	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-
	KW	1.34	1.37	1.42	-	1.45	1.49	1.54	-	1.55	1.59	1.65	-	1.64	1.68	1.74	-	1.72	1.76	1.82	-	1.78	1.82	1.89	-
	Amps	5.6	5.8	6.0	-	6.1	6.3	6.5	-	6.7	6.8	7.1	-	7.1	7.3	7.6	-	7.6	7.8	8.1	-	8.1	8.3	8.6	-
	Hi PR	222	239	252	-	249	268	283	-	283	305	322	-	323	347	367	-	363	391	412	-	401	432	456	-
Lo PR	105	111	122	-	111	118	128	-	115	122	133	-	121	128	140	-	126	135	147	-	131	139	152	-	
80	MBh	22.9	23.8	26.0	-	22.4	23.2	25.4	-	21.9	22.7	24.8	-	21.3	22.1	24.2	-	20.3	21.0	23.0	-	18.8	19.5	21.3	-
	S/T	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.81	0.68	0.47	-	0.84	0.70	0.49	-	0.85	0.71	0.49	-
	ΔT	19	16	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
	KW	1.35	1.39	1.43	-	1.47	1.50	1.55	-	1.57	1.61	1.66	-	1.66	1.70	1.76	-	1.73	1.77	1.84	-	1.80	1.84	1.91	-
	Amps	5.7	5.8	6.0	-	6.2	6.3	6.5	-	6.7	6.9	7.1	-	7.2	7.4	7.6	-	7.7	7.9	8.1	-	8.2	8.4	8.6	-
	Hi PR	224	241	255	-	252	271	286	-	286	308	325	-	326	351	370	-	367	394	417	-	405	436	460	-
Lo PR	106	112	123	-	112	119	130	-	116	123	135	-	122	130	142	-	128	136	148	-	132	141	153	-	
620	MBh	20.9	21.5	23.3	25.0	20.4	21.0	22.7	24.4	19.9	20.5	22.2	23.8	19.4	20.0	21.7	23.3	18.5	19.0	20.6	22.1	17.1	17.6	19.1	20.5
	S/T	0.77	0.69	0.52	0.3	0.80	0.72	0.54	0.3	0.82	0.74	0.56	0.4	0.85	0.76	0.57	0.4	0.88	0.79	0.60	0.4	0.89	0.79	0.60	0.4
	ΔT	24	22	18	12	24	22	18	13	24	22	18	13	24	23	18	13	23	21	18	13	23	21	17	12
	KW	1.32	1.35	1.40	1.4	1.43	1.46	1.51	1.6	1.53	1.56	1.62	1.7	1.61	1.65	1.71	1.8	1.69	1.73	1.79	1.9	1.75	1.79	1.85	1.9
	Amps	5.5	5.7	5.9	6.1	6.0	6.2	6.4	6.6	6.5	6.7	6.9	7.2	7.0	7.2	7.4	7.7	7.5	7.7	7.9	8.2	7.9	8.1	8.4	8.7
	Hi PR	218	234	247	258	244	263	277	289	278	299	315	329	316	340	359	375	356	383	404	422	393	423	447	466
Lo PR	103	109	119	127	108	115	126	134	113	120	131	139	118	126	137	146	124	132	144	153	128	136	149	159	
70	MBh	22.6	23.3	25.2	27.1	22.1	22.8	24.6	26.4	21.6	22.2	24.1	25.8	21.1	21.7	23.5	25.2	20.0	20.6	22.3	23.9	18.5	19.1	20.7	22.2
	S/T	0.80	0.72	0.54	0.3	0.83	0.74	0.56	0.4	0.85	0.76	0.58	0.4	0.88	0.79	0.60	0.4	0.91	0.82	0.62	0.4	0.92	0.82	0.62	0.4
	ΔT	23	21	18	12	23	22	18	12	24	22	18	12	24	22	18	12	23	21	18	12	22	20	16	11
	KW	1.35	1.39	1.43	1.5	1.47	1.50	1.55	1.6	1.57	1.61	1.66	1.7	1.66	1.70	1.76	1.8	1.73	1.77	1.84	1.9	1.80	1.84	1.91	2.0
	Amps	5.7	5.8	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.5	8.2	8.4	8.6	9.0
	Hi PR	224	241	255	266	252	271	286	298	286	308	325	339	326	351	370	386	367	395	417	435	405	436	460	480
Lo PR	106	112	123	131	112	119	130	138	116	123	135	144	122	130	142	151	128	136	148	158	132	141	153	163	
80	MBh	23.3	24.0	26.0	27.9	22.8	23.5	25.4	27.2	22.2	22.9	24.8	26.6	21.7	22.3	24.2	25.9	20.6	21.2	23.0	24.6	19.1	19.7	21.3	22.8
	S/T	0.84	0.75	0.57	0.4	0.87	0.78	0.59	0.4	0.89	0.80	0.61	0.4	0.92	0.83	0.62	0.4	0.96	0.86	0.65	0.4	0.97	0.86	0.65	0.4
	ΔT	22	20	17	11	22	21	17	12	22	21	17	12	22	21	17	12	21	20	17	12	21	19	16	11
	KW	1.37	1.40	1.45	1.5	1.48	1.52	1.57	1.6	1.58	1.62	1.68	1.7	1.67	1.71	1.77	1.8	1.75	1.79	1.85	1.9	1.81	1.86	1.92	2.0
	Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	8.0	8.2	8.5	8.2	8.4	8.7	9.1
	Hi PR	226	244	257	268	254	273	289	301	289	311	328	343	329	354	374	390	370	399	421	439	409	440	465	485
Lo PR	107	114	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	

IDB*: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions.
 kW = Total system power
 Amps = outdoor unit amps

IDB*	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
620	MBh	21.3	21.7	23.2	24.8	20.8	21.2	22.7	24.2	20.3	20.7	22.1	23.7	19.8	20.2	21.6	23.1	18.8	19.2	20.5	21.9	17.4	17.8	19.0	20.3
	S/T	0.85	0.80	0.65	0.5	0.88	0.82	0.67	0.5	0.90	0.85	0.69	0.5	0.93	0.87	0.71	0.5	0.97	0.91	0.74	0.6	0.97	0.91	0.74	0.6
	ΔT	27	26	22	18	27	26	23	18	27	26	23	18	27	26	23	18	27	26	22	18	25	24	21	17
	kW	1.33	1.36	1.41	1.5	1.44	1.48	1.53	1.6	1.54	1.58	1.63	1.7	1.63	1.67	1.72	1.8	1.70	1.74	1.80	1.9	1.77	1.81	1.87	1.9
	Amps	5.6	5.7	5.9	6.2	6.1	6.2	6.4	6.7	6.6	6.8	7.0	7.3	7.1	7.2	7.5	7.8	7.5	7.7	8.0	8.3	8.0	8.2	8.5	8.8
	Hi/PR	220	236	250	260	247	265	280	292	280	302	319	332	319	344	363	378	359	387	408	426	397	427	451	470
Lo/PR	104	110	120	128	109	116	127	135	114	121	132	141	119	127	139	148	125	133	145	155	129	138	150	160	
80	MBh	23.0	23.5	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.4	24.0	25.6	21.4	21.9	23.4	25.0	20.4	20.8	22.2	23.8	18.9	19.3	20.6	22.0
	S/T	0.88	0.83	0.67	0.5	0.91	0.86	0.70	0.5	0.94	0.88	0.71	0.5	0.97	0.91	0.74	0.6	1.00	0.94	0.76	0.6	1.00	0.95	0.77	0.6
	ΔT	26	25	22	17	26	25	22	17	26	25	22	17	26	25	22	17	26	25	22	17	24	23	20	16
	kW	1.37	1.40	1.45	1.5	1.48	1.52	1.57	1.6	1.58	1.62	1.68	1.7	1.67	1.71	1.77	1.8	1.75	1.79	1.85	1.9	1.81	1.86	1.92	2.0
	Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	8.0	8.2	8.5	8.2	8.4	8.7	9.1
	Hi/PR	226	244	257	268	254	273	289	301	289	311	328	343	329	354	374	390	370	399	421	439	409	440	465	485
Lo/PR	107	114	124	132	113	120	131	140	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	
820	MBh	23.7	24.3	25.9	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	22.1	22.6	24.1	25.8	21.0	21.4	22.9	24.5	19.4	19.9	21.2	22.7
	S/T	0.92	0.87	0.70	0.5	0.96	0.90	0.73	0.5	1.00	0.92	0.75	0.6	1.00	0.95	0.77	0.6	1.00	1.00	0.80	0.6	1.00	1.00	0.81	0.6
	ΔT	25	24	20	16	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	16	22	22	19	15
	kW	1.38	1.41	1.46	1.5	1.49	1.53	1.58	1.6	1.60	1.63	1.69	1.8	1.69	1.73	1.79	1.9	1.76	1.81	1.87	1.9	1.83	1.87	1.94	2.0
	Amps	5.8	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.9	7.0	7.3	7.6	7.3	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.8	9.2
	Hi/PR	229	246	260	271	257	276	292	304	292	314	332	346	333	358	378	394	374	403	425	443	413	445	470	490
Lo/PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167	

620	MBh	21.6	22.1	23.1	24.6	21.1	21.5	22.6	24.1	20.6	21.0	22.0	23.5	20.1	20.5	21.5	22.9	19.1	19.5	20.4	21.8	17.7	18.1	18.9	20.2
	S/T	0.89	0.86	0.77	0.6	0.92	0.89	0.80	0.7	0.95	0.91	0.82	0.7	0.98	0.94	0.85	0.7	1.00	0.98	0.88	0.7	1.00	0.99	0.89	0.7
	ΔT	29	28	27	23	29	28	27	23	29	28	27	23	29	29	29	23	28	28	27	23	26	26	25	22
	kW	1.34	1.37	1.42	1.5	1.45	1.49	1.54	1.6	1.55	1.59	1.65	1.7	1.64	1.68	1.74	1.8	1.72	1.76	1.82	1.9	1.78	1.82	1.89	2.0
	Amps	5.6	5.8	6.0	6.2	6.1	6.3	6.5	6.7	6.7	6.8	7.1	7.3	7.1	7.3	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.6	8.9
	Hi/PR	222	239	252	263	249	268	283	295	283	305	322	336	323	347	367	382	363	390	412	430	401	431	456	475
Lo/PR	105	111	121	129	110	118	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	
720	MBh	23.4	23.9	25.0	26.7	22.9	23.3	24.4	26.1	22.4	22.8	23.9	25.5	21.8	22.2	23.3	24.8	20.7	21.1	22.1	23.6	19.2	19.6	20.5	21.9
	S/T	0.92	0.89	0.80	0.7	0.96	0.92	0.83	0.7	0.98	0.95	0.85	0.7	1.00	0.98	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.92	0.7
	ΔT	28	27	26	22	28	28	26	23	28	28	26	23	28	28	26	23	26	27	26	22	25	25	24	21
	kW	1.38	1.41	1.46	1.5	1.49	1.53	1.58	1.6	1.60	1.63	1.69	1.8	1.69	1.73	1.79	1.9	1.76	1.81	1.87	1.9	1.83	1.87	1.94	2.0
	Amps	5.8	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.9	7.0	7.3	7.6	7.3	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.8	9.2
	Hi/PR	229	246	260	271	257	276	292	304	292	314	332	346	333	358	378	394	374	403	425	443	413	445	470	490
Lo/PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167	
820	MBh	24.1	24.6	25.8	27.5	23.6	24.0	25.2	26.9	23.0	23.5	24.6	26.2	22.5	22.9	24.0	25.6	21.3	21.8	22.8	24.3	19.8	20.2	21.1	22.5
	S/T	0.97	0.93	0.84	0.7	1.00	0.97	0.87	0.7	1.00	0.99	0.90	0.7	1.00	1.00	0.92	0.7	1.00	1.00	0.96	0.8	1.00	1.00	0.97	0.8
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	25	26	25	22	24	24	25	21	22	23	23	20
	kW	1.39	1.42	1.47	1.5	1.51	1.54	1.60	1.7	1.61	1.65	1.71	1.8	1.70	1.74	1.80	1.9	1.78	1.82	1.89	2.0	1.85	1.89	1.96	2.0
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.6	7.9	8.2	7.9	8.1	8.4	8.7	8.4	8.6	8.9	9.2
	Hi/PR	231	249	263	274	259	279	295	307	295	317	335	349	336	361	382	398	378	407	429	448	417	449	474	495
Lo/PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168	

IDB*: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI conditions.

kW = Total system power
Amps = outdoor unit amps

IDB*		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
480	MBh	13.9	14.4	15.8	-	13.6	14.1	15.4	-	13.3	13.8	15.1	-	12.9	13.4	14.7	-	12.3	12.7	14.0	-	11.4	11.8	12.9	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
	kW	0.82	0.84	0.87	-	0.89	0.91	0.93	-	0.94	0.96	0.99	-	0.99	1.01	1.04	-	1.03	1.05	1.09	-	1.07	1.09	1.13	-
	Amps	3.3	3.4	3.5	-	3.6	3.7	3.8	-	3.9	4.0	4.1	-	4.1	4.2	4.4	-	4.4	4.5	4.7	-	4.7	4.8	4.9	-
	Hi PR	208	224	236	-	233	251	265	-	265	286	302	-	302	325	343	-	340	366	386	-	376	404	427	-
	Lo PR	105	112	122	-	111	118	129	-	116	123	134	-	122	129	141	-	127	136	148	-	132	140	153	-
	MBh	14.7	15.2	16.6	-	14.3	14.8	16.3	-	14.0	14.5	15.9	-	13.6	14.1	15.5	-	12.9	13.4	14.7	-	12.0	12.4	13.6	-
	S/T	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.45	-	0.80	0.66	0.46	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
540	kW	0.84	0.85	0.88	-	0.90	0.92	0.95	-	0.96	0.98	1.01	-	1.01	1.03	1.06	-	1.05	1.07	1.11	-	1.09	1.11	1.15	-
	Amps	3.4	3.4	3.6	-	3.6	3.7	3.8	-	3.9	4.0	4.2	-	4.2	4.3	4.5	-	4.5	4.6	4.7	-	4.7	4.9	5.0	-
	Hi PR	212	228	241	-	238	256	271	-	271	291	308	-	308	332	350	-	347	373	394	-	383	413	436	-
	Lo PR	108	114	125	-	114	121	132	-	118	126	137	-	124	132	144	-	130	138	151	-	134	143	156	-
	MBh	15.1	15.6	17.1	-	14.7	15.3	16.7	-	14.4	14.9	16.3	-	14.0	14.5	15.9	-	13.3	13.8	15.1	-	12.4	12.8	14.0	-
	S/T	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.81	0.67	0.47	-	0.83	0.70	0.48	-	0.87	0.72	0.50	-	0.87	0.73	0.50	-
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	11	-
	kW	0.84	0.86	0.89	-	0.91	0.93	0.96	-	0.96	0.99	1.02	-	1.02	1.04	1.07	-	1.06	1.08	1.12	-	1.09	1.12	1.16	-
	Amps	3.4	3.5	3.6	-	3.7	3.8	3.9	-	4.0	4.1	4.2	-	4.3	4.4	4.5	-	4.5	4.6	4.8	-	4.8	4.9	5.1	-
	Hi PR	214	231	244	-	240	259	273	-	274	294	311	-	312	335	354	-	350	377	398	-	387	417	440	-
Lo PR	109	116	126	-	115	122	133	-	119	127	139	-	125	133	146	-	131	140	152	-	136	144	158	-	
620	MBh	14.2	14.6	15.8	16.9	13.8	14.2	15.4	16.5	13.5	13.9	15.0	16.1	13.2	13.6	14.7	15.7	12.5	12.9	13.9	15.0	11.6	11.9	12.9	13.9
	S/T	0.79	0.71	0.53	0.3	0.82	0.73	0.55	0.4	0.84	0.75	0.57	0.4	0.87	0.77	0.59	0.4	0.90	0.80	0.61	0.4	0.91	0.81	0.61	0.4
	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	10
	kW	0.83	0.85	0.87	0.9	0.89	0.91	0.94	1.0	0.95	0.97	1.00	1.0	1.00	1.02	1.05	1.1	1.04	1.06	1.10	1.1	1.08	1.10	1.14	1.2
	Amps	3.3	3.4	3.5	3.7	3.6	3.7	3.8	3.9	3.9	4.0	4.1	4.3	4.2	4.3	4.4	4.6	4.4	4.5	4.7	4.9	4.7	4.8	5.0	5.2
	Hi PR	210	226	239	249	236	254	268	279	268	289	305	318	305	329	347	362	344	370	390	407	380	408	431	450
	Lo PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165
	MBh	14.9	15.3	16.6	17.8	14.6	15.0	16.2	17.4	14.2	14.6	15.8	17.0	13.9	14.3	15.4	16.6	13.2	13.6	14.7	15.7	12.2	12.6	13.6	14.6
	S/T	0.82	0.74	0.56	0.4	0.85	0.76	0.58	0.4	0.88	0.78	0.59	0.4	0.90	0.81	0.61	0.4	0.94	0.84	0.64	0.4	0.95	0.85	0.64	0.4
	ΔT	21	19	16	11	21	19	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
75	kW	0.84	0.86	0.89	0.9	0.91	0.93	0.96	1.0	0.96	0.99	1.02	1.1	1.02	1.04	1.07	1.1	1.06	1.08	1.12	1.2	1.09	1.12	1.16	1.2
	Amps	3.4	3.5	3.6	3.7	3.7	3.8	3.9	4.0	4.0	4.1	4.2	4.4	4.3	4.4	4.5	4.7	4.5	4.6	4.8	5.0	4.8	4.9	5.1	5.3
	Hi PR	214	231	244	254	241	259	273	285	274	294	311	324	312	335	354	369	351	377	398	415	387	417	440	459
	Lo PR	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	162	136	145	158	168
	MBh	15.3	15.8	17.1	18.4	15.0	15.4	16.7	17.9	14.6	15.1	16.3	17.5	14.3	14.7	15.9	17.1	13.6	14.0	15.1	16.2	12.6	12.9	14.0	15.0
	S/T	0.86	0.77	0.59	0.4	0.90	0.80	0.61	0.4	0.92	0.82	0.62	0.4	0.95	0.85	0.64	0.4	0.98	0.88	0.67	0.4	0.99	0.89	0.67	0.4
	ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	18	17	14	10
	kW	0.85	0.87	0.90	0.9	0.92	0.94	0.96	1.0	0.97	0.99	1.03	1.1	1.02	1.05	1.08	1.1	1.07	1.09	1.13	1.2	1.10	1.13	1.17	1.2
	Amps	3.4	3.5	3.6	3.8	3.7	3.8	3.9	4.1	4.0	4.1	4.2	4.4	4.3	4.4	4.5	4.7	4.6	4.7	4.8	5.0	4.8	4.9	5.1	5.3
	Hi PR	217	233	246	257	243	261	276	288	276	297	314	327	315	339	358	373	354	381	402	420	391	421	445	464
Lo PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	

kW = Total system power
Amps = outdoor unit amps

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB*		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		ENTERING INDOOR WET BULB TEMPERATURE																							
AIRFLOW		59	63	67	71	71	71	71	59	63	67	71	71	71	59	63	67	71	71	59	63	67	71	71	
480	MBh	14.4	14.7	15.7	16.8	14.1	14.4	15.4	16.4	13.7	14.0	15.0	16.0	13.4	13.7	14.6	15.6	12.7	13.0	13.9	14.9	11.8	12.1	12.9	13.8
	S/T	0.87	0.81	0.66	0.5	0.90	0.84	0.68	0.5	0.92	0.86	0.70	0.5	0.95	0.89	0.73	0.5	0.99	0.92	0.75	0.6	0.99	0.93	0.76	0.6
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	22	19	15
	kW	0.84	0.85	0.88	0.9	0.90	0.92	0.95	1.0	0.96	0.98	1.01	1.0	1.01	1.03	1.06	1.1	1.05	1.07	1.11	1.1	1.09	1.11	1.15	1.2
	Amps	3.4	3.4	3.6	3.7	3.6	3.7	3.8	4.0	3.9	4.0	4.2	4.3	4.2	4.3	4.5	4.6	4.5	4.6	4.7	4.9	4.7	4.9	5.0	5.2
	Hi/PR	212	228	241	252	238	256	271	282	271	291	308	321	308	332	350	366	347	373	394	411	383	413	436	454
Lo/PR	108	114	125	133	114	121	132	141	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	
540	MBh	15.2	15.5	16.6	17.7	14.8	15.1	16.2	17.3	14.5	14.8	15.8	16.9	14.1	14.4	15.4	16.5	13.4	13.7	14.6	15.6	12.4	12.7	13.6	14.5
	S/T	0.90	0.85	0.69	0.5	0.94	0.88	0.72	0.5	0.96	0.90	0.73	0.5	0.99	0.93	0.76	0.6	1.00	0.97	0.79	0.6	1.00	0.97	0.79	0.6
	ΔT	23	22	19	16	24	23	20	16	24	23	20	16	24	23	20	16	23	23	20	16	21	21	18	15
	kW	0.85	0.87	0.90	0.9	0.92	0.94	0.97	1.0	0.97	0.99	1.03	1.1	1.02	1.05	1.08	1.1	1.07	1.09	1.13	1.2	1.10	1.13	1.17	1.2
	Amps	3.4	3.5	3.6	3.8	3.7	3.8	3.9	4.1	4.0	4.1	4.2	4.4	4.3	4.4	4.5	4.7	4.6	4.7	4.8	5.0	4.8	5.0	5.1	5.3
	Hi/PR	217	233	246	257	243	261	276	288	276	297	314	328	315	339	358	373	354	381	402	420	391	421	445	464
Lo/PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	
620	MBh	15.6	16.0	17.1	18.2	15.3	15.6	16.7	17.8	14.9	15.2	16.3	17.4	14.5	14.8	15.9	17.0	13.8	14.1	15.1	16.1	12.8	13.1	14.0	14.9
	S/T	0.95	0.89	0.72	0.5	1.00	0.92	0.75	0.6	1.00	0.94	0.77	0.6	1.00	1.00	0.79	0.6	1.00	1.00	0.82	0.6	1.00	1.00	0.83	0.6
	ΔT	22	21	18	15	23	21	19	15	22	21	19	15	22	22	19	15	20	21	18	15	19	19	17	14
	kW	0.86	0.88	0.90	0.9	0.92	0.94	0.97	1.0	0.98	1.00	1.03	1.1	1.03	1.05	1.09	1.1	1.08	1.10	1.14	1.2	1.11	1.14	1.18	1.2
	Amps	3.5	3.5	3.7	3.8	3.7	3.8	3.9	4.1	4.1	4.2	4.3	4.4	4.3	4.4	4.6	4.8	4.6	4.7	4.9	5.1	4.9	5.0	5.2	5.4
	Hi/PR	219	235	249	259	245	264	279	291	279	300	317	331	318	342	361	377	358	385	406	424	395	425	449	468
Lo/PR	111	118	129	137	117	125	136	145	122	129	141	151	128	136	148	158	134	143	156	166	139	147	161	171	

480	MBh	14.7	14.9	15.6	16.7	14.3	14.6	15.3	16.3	14.0	14.2	14.9	15.9	13.6	13.9	14.6	15.5	13.0	13.2	13.8	14.8	12.0	12.2	12.8	13.7
	S/T	0.91	0.88	0.79	0.6	0.94	0.91	0.82	0.7	0.96	0.93	0.84	0.7	1.00	0.96	0.87	0.7	1.00	1.00	0.90	0.7	1.00	1.00	0.91	0.7
	ΔT	25	25	24	21	26	25	24	21	26	25	24	21	26	26	24	21	25	25	24	21	23	23	22	19
	kW	0.84	0.86	0.89	0.9	0.91	0.93	0.96	1.0	0.96	0.99	1.02	1.1	1.02	1.04	1.07	1.1	1.06	1.08	1.12	1.2	1.09	1.12	1.16	1.2
	Amps	3.4	3.5	3.6	3.7	3.7	3.8	3.9	4.0	4.0	4.1	4.2	4.4	4.3	4.4	4.5	4.7	4.5	4.6	4.8	5.0	4.8	4.9	5.1	5.3
	Hi/PR	214	231	244	254	240	259	273	285	274	294	311	324	312	335	354	369	350	377	398	415	387	417	440	459
Lo/PR	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	152	162	136	144	158	168	
540	MBh	15.4	15.7	16.5	17.6	15.1	15.4	16.1	17.2	14.7	15.0	15.7	16.8	14.4	14.6	15.3	16.3	13.6	13.9	14.6	15.5	12.6	12.9	13.5	14.4
	S/T	0.95	0.91	0.83	0.7	0.98	0.95	0.86	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.94	0.8	1.00	1.00	0.95	0.8
	ΔT	25	24	23	20	25	25	23	20	25	25	23	20	24	25	24	20	23	24	23	20	22	22	22	19
	kW	0.86	0.88	0.90	0.9	0.92	0.94	0.97	1.0	0.98	1.00	1.03	1.1	1.03	1.05	1.09	1.1	1.08	1.10	1.14	1.2	1.11	1.14	1.18	1.2
	Amps	3.5	3.5	3.7	3.8	3.7	3.8	3.9	4.1	4.1	4.2	4.3	4.4	4.3	4.4	4.6	4.8	4.6	4.7	4.9	5.1	4.9	5.0	5.2	5.4
	Hi/PR	219	235	249	259	245	264	279	291	279	300	317	331	318	342	361	377	358	385	406	424	395	425	449	468
Lo/PR	111	118	129	137	117	125	136	145	122	129	141	151	128	136	148	158	134	143	156	166	139	147	161	171	
620	MBh	15.9	16.2	17.0	18.1	15.5	15.8	16.6	17.7	15.2	15.4	16.2	17.3	14.8	15.1	15.8	16.8	14.0	14.3	15.0	16.0	13.0	13.3	13.9	14.8
	S/T	0.99	0.96	0.87	0.7	1.00	0.99	0.90	0.7	1.00	1.00	0.92	0.7	1.00	1.00	0.95	0.8	1.00	1.00	0.99	0.8	1.00	1.00	0.99	0.8
	ΔT	23	23	22	19	23	23	22	19	22	23	22	19	22	22	22	19	21	21	22	19	19	20	20	18
	kW	0.86	0.88	0.91	0.9	0.93	0.95	0.98	1.0	0.99	1.01	1.04	1.1	1.04	1.06	1.10	1.1	1.08	1.11	1.15	1.2	1.12	1.15	1.19	1.2
	Amps	3.5	3.6	3.7	3.8	3.8	3.9	4.0	4.1	4.1	4.2	4.3	4.5	4.4	4.5	4.6	4.8	4.6	4.8	4.9	5.1	4.9	5.0	5.2	5.4
	Hi/PR	221	238	251	262	248	267	282	294	282	303	320	334	321	345	365	381	361	389	410	428	399	429	453	473
Lo/PR	112	119	130	138	118	126	137	146	123	131	143	152	129	137	150	160	135	144	157	167	140	149	163	173	

kW = Total system power
Amps = outdoor unit amps

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB*		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE													
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	AIRFLOW	MBh	33.2	34.4	37.7	-	32.4	33.6	36.8	-	31.6	32.8	35.9	-	30.9	32.0	35.0	-	29.3	30.4	33.3	-	27.2	28.1	30.8	-	
		S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	
	ΔT	20	18	13	-	21	18	14	-	21	18	14	-	21	18	14	-	20	18	13	-	19	17	13	-		
	1050	KW	1.91	1.95	2.01	-	2.06	2.11	2.18	-	2.19	2.24	2.32	-	2.31	2.37	2.45	-	2.42	2.47	2.56	-	2.50	2.56	2.65	-	
		Amps	7.7	7.9	8.2	-	8.4	8.6	8.9	-	9.1	9.3	9.7	-	9.8	10.0	10.3	-	10.4	10.7	11.0	-	11.0	11.3	11.7	-	
	Hi PR	213	230	243	-	240	258	272	-	272	293	310	-	310	334	353	-	349	376	397	-	386	415	438	-		
		Lo PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	139	-	126	134	146	-	130	138	151	-	
	1160	AIRFLOW	MBh	33.7	34.9	38.2	-	32.9	34.1	37.4	-	32.1	33.3	36.5	-	31.3	32.5	35.6	-	29.8	30.8	33.8	-	27.6	28.6	31.3	-
			S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-
		ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
1160		KW	1.93	1.98	2.04	-	2.09	2.14	2.21	-	2.23	2.28	2.36	-	2.35	2.40	2.48	-	2.45	2.51	2.59	-	2.54	2.60	2.69	-	
		Amps	7.9	8.1	8.3	-	8.5	8.7	9.0	-	9.3	9.5	9.8	-	9.9	10.2	10.5	-	10.6	10.8	11.2	-	11.2	11.5	11.9	-	
Hi PR		217	234	247	-	244	262	277	-	277	298	315	-	316	340	359	-	355	382	404	-	392	422	446	-		
		Lo PR	106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	149	-	132	141	154	-	
1350		AIRFLOW	MBh	34.7	36.0	39.4	-	33.9	35.1	38.5	-	33.1	34.3	37.6	-	32.3	33.4	36.6	-	30.7	31.8	34.8	-	28.4	29.4	32.2	-
			S/T	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.81	0.68	0.47	-	0.84	0.70	0.48	-	0.87	0.72	0.50	-	0.88	0.73	0.51	-
		ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	
	1350	KW	1.95	1.99	2.06	-	2.11	2.15	2.23	-	2.25	2.30	2.38	-	2.37	2.42	2.51	-	2.47	2.53	2.62	-	2.56	2.62	2.71	-	
		Amps	7.9	8.1	8.4	-	8.6	8.8	9.1	-	9.4	9.6	9.9	-	10.0	10.3	10.6	-	10.7	10.9	11.3	-	11.3	11.6	12.0	-	
	Hi PR	219	236	249	-	246	265	280	-	280	301	318	-	319	343	362	-	359	386	408	-	396	426	450	-		
		Lo PR	107	114	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	134	142	155	-	

75	AIRFLOW	MBh	33.7	34.7	37.6	40.4	33.0	33.9	36.7	39.4	32.2	33.1	35.8	38.5	31.4	32.3	35.0	37.5	29.8	30.7	33.2	35.7	27.6	28.4	30.8	33.0	
		S/T	0.80	0.71	0.54	0.4	0.83	0.74	0.56	0.4	0.85	0.76	0.57	0.4	0.87	0.78	0.59	0.4	0.91	0.81	0.61	0.4	0.92	0.82	0.62	0.4	
	ΔT	24	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	22	20	17	12		
	1050	KW	1.92	1.97	2.03	2.1	2.08	2.12	2.20	2.3	2.21	2.26	2.34	2.4	2.33	2.39	2.47	2.6	2.44	2.49	2.58	2.7	2.53	2.58	2.67	2.8	
		Amps	7.8	8.0	8.3	8.6	8.5	8.7	9.0	9.3	9.2	9.4	9.8	10.1	9.9	10.1	10.4	10.8	10.5	10.8	11.1	11.6	11.1	11.4	11.8	12.3	
	Hi PR	216	232	245	256.0	242	260	275	287.0	275	296	313	326.0	313	337	356	371.0	353	379	401	418.0	390	419	443	462.0		
		Lo PR	105	112	122	130.0	111	118	129	137.0	115	123	134	143.0	121	129	141	150.0	127	135	148	157.0	131	140	153	163.0	
	1160	AIRFLOW	MBh	34.2	35.3	38.2	41.0	33.5	34.4	37.3	40.0	32.7	33.6	36.4	39.1	31.9	32.8	35.5	38.1	30.3	31.2	33.7	36.2	28.0	28.9	31.2	33.5
			S/T	0.83	0.74	0.56	0.4	0.86	0.77	0.58	0.4	0.88	0.79	0.59	0.4	0.91	0.81	0.61	0.4	0.94	0.84	0.64	0.4	0.95	0.85	0.64	0.4
		ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
1160		KW	1.95	1.99	2.06	2.1	2.11	2.16	2.23	2.3	2.25	2.30	2.38	2.5	2.37	2.42	2.51	2.6	2.47	2.53	2.62	2.7	2.56	2.62	2.71	2.8	
		Amps	7.9	8.1	8.4	8.7	8.6	8.8	9.1	9.5	9.4	9.6	9.9	10.3	10.0	10.3	10.6	11.0	10.7	10.9	11.3	11.8	11.3	11.6	12.0	12.5	
Hi PR		219	236	249	260.0	246	265	280	292.0	280	301	318	332.0	319	343	362	378.0	359	386	408	425.0	396	427	450	470.0		
		Lo PR	107	114	124	132.0	113	120	131	140.0	117	125	136	145.0	123	131	143	153.0	129	138	150	160.0	134	142	155	165.0	
1350		AIRFLOW	MBh	35.3	36.3	39.3	42.2	34.5	35.5	38.4	41.2	33.6	34.6	37.5	40.2	32.8	33.8	36.6	39.3	31.2	32.1	34.7	37.3	28.9	29.7	32.2	34.5
			S/T	0.87	0.78	0.59	0.4	0.90	0.80	0.61	0.4	0.92	0.82	0.62	0.4	0.95	0.85	0.64	0.4	0.99	0.88	0.67	0.4	0.99	0.89	0.67	0.4
		ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	20	16	11	21	19	16	11	20	18	15	10	
	1350	KW	1.97	2.01	2.08	2.2	2.13	2.17	2.25	2.3	2.27	2.32	2.40	2.5	2.39	2.44	2.53	2.6	2.49	2.55	2.64	2.7	2.59	2.65	2.74	2.8	
		Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.0	11.4	11.9	11.4	11.7	12.1	12.6	
	Hi PR	222	238	252	263.0	249	268	283	295.0	283	304	321	335.0	322	347	366	382.0	362	390	412	429.0	400	431	455	474.0		
		Lo PR	108	115	125	134.0	114	121	133	141.0	119	126	138	147.0	125	133	145	154.0	131	139	152	161.0	135	144	157	167.0	

IDB*: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TYA) conditions
 kW = Total system power
 Amps = outdoor unit amps

EXPANDED COOLING DATA — AVZC200361A* / CA*F3743*6D* + MBVC1600** -1A*+TXV (HIGH STAGE)

IDB*	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	1050	MBh	34.3	35.1	37.5	40.1	33.5	34.3	36.6	39.1	32.7	33.5	35.7	38.2	31.9	32.6	34.9	37.3	30.3	31.0	33.1	35.4	28.1	28.7	30.7	32.8
		S/T	0.87	0.82	0.67	0.5	0.91	0.85	0.69	0.5	0.93	0.87	0.71	0.5	0.96	0.90	0.73	0.6	1.00	0.93	0.76	0.6	1.00	0.94	0.77	0.6
	ΔT	26	25	22	18	27	25	22	18	27	26	22	18	27	26	22	18	26	26	25	22	18	25	24	21	16
	kW	1.94	1.98	2.05	2.1	2.10	2.14	2.21	2.3	2.23	2.28	2.36	2.4	2.35	2.41	2.49	2.6	2.46	2.52	2.60	2.7	2.55	2.61	2.70	2.8	
	Amps	7.9	8.1	8.3	8.7	8.5	8.7	9.0	9.4	9.3	9.5	9.8	10.2	9.9	10.2	10.5	11.0	10.6	10.9	11.2	11.7	11.2	11.5	11.9	12.4	
	Hi PR	218	234	248	258.0	244	263	278	290.0	278	299	316	329.0	317	341	360	375.0	356	383	405	422.0	394	424	447	466.0	
	Lo PR	106	113	123	131.0	112	119	130	139.0	117	124	135	144.0	122	130	142	151.0	128	137	149	159.0	133	141	154	164.0	
	MBh	34.9	35.6	38.1	40.7	34.0	34.8	37.2	39.7	33.2	34.0	36.3	38.8	32.4	33.1	35.4	37.8	30.8	31.5	33.6	36.0	28.5	29.2	31.2	33.3	
	S/T	0.91	0.85	0.69	0.5	0.94	0.88	0.72	0.5	0.96	0.90	0.74	0.6	0.99	0.93	0.76	0.6	1.00	0.97	0.79	0.6	1.00	0.98	0.79	0.6	
	ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	24	21	17	24	24	21	17	23	23	20	16	
kW	1.97	2.01	2.08	2.2	2.13	2.17	2.25	2.3	2.27	2.32	2.40	2.5	2.39	2.44	2.53	2.6	2.50	2.55	2.64	2.7	2.59	2.65	2.74	2.8		
Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.0	11.4	11.9	11.4	11.7	12.1	12.6		
Hi PR	222	238	252	263.0	249	268	283	295.0	283	304	321	335.0	322	347	366	382.0	362	390	412	429.0	400	431	455	475.0		
Lo PR	108	115	125	134.0	114	121	133	141.0	119	126	138	147.0	125	133	145	154.0	131	139	152	162.0	135	144	157	167.0		
MBh	35.9	36.7	39.2	41.9	35.1	35.8	38.3	40.9	34.2	35.0	37.4	40.0	33.4	34.1	36.5	39.0	31.7	32.4	34.6	37.0	29.4	30.0	32.1	34.3		
S/T	0.95	0.89	0.73	0.5	1.00	0.92	0.75	0.6	1.00	0.95	0.77	0.6	1.00	1.00	0.80	0.6	1.00	1.00	0.83	0.6	1.00	1.00	0.83	0.6		
ΔT	23	22	19	15	24	23	20	16	23	23	20	16	23	23	20	16	22	22	19	16	20	20	18	15		
kW	1.98	2.03	2.09	2.2	2.14	2.19	2.27	2.3	2.29	2.34	2.42	2.5	2.41	2.47	2.55	2.6	2.52	2.58	2.66	2.8	2.61	2.67	2.76	2.9		
Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.8	10.1	10.5	10.2	10.5	10.8	11.2	10.9	11.2	11.5	12.0	11.5	11.8	12.2	12.7		
Hi PR	224	241	254	265.0	251	270	285	298.0	286	307	325	339.0	325	350	370	386.0	366	394	416	434.0	404	435	459	479.0		
Lo PR	109	116	127	135.0	115	123	134	143.0	120	127	139	148.0	126	134	146	156.0	132	140	153	163.0	136	145	158	169.0		

85	1050	MBh	34.9	35.6	37.3	39.8	34.1	34.8	36.4	38.9	33.3	34.0	35.6	37.9	32.5	33.1	34.7	37.0	30.9	31.5	33.0	35.2	28.6	29.2	30.5	32.6
		S/T	0.92	0.88	0.80	0.7	0.95	0.92	0.83	0.7	0.97	0.94	0.85	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.92	0.7
	ΔT	28	28	26	23	28	28	26	23	28	28	26	23	28	28	26	23	23	27	28	26	23	25	26	24	21
	kW	1.95	2.00	2.06	2.1	2.11	2.16	2.23	2.3	2.25	2.30	2.38	2.5	2.38	2.43	2.51	2.6	2.48	2.54	2.62	2.7	2.57	2.63	2.72	2.8	
	Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.5	9.4	9.6	9.9	10.3	10.0	10.3	10.6	11.1	10.7	11.0	11.3	11.8	11.4	11.6	12.0	12.5	
	Hi PR	220	237	250	261.0	247	266	281	293.0	281	302	319	333.0	320	344	363	379.0	360	387	409	426.0	397	428	452	471.0	
	Lo PR	107	114	125	133.0	113	121	132	140.0	118	125	137	146.0	124	132	144	153.0	130	138	151	160.0	134	143	156	166.0	
	MBh	35.5	36.2	37.9	40.4	34.6	35.3	37.0	39.5	33.8	34.5	36.1	38.5	33.0	33.6	35.2	37.6	31.3	31.9	33.5	35.7	29.0	29.6	31.0	33.1	
	S/T	0.95	0.92	0.83	0.7	0.98	0.95	0.86	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.94	0.8	1.00	1.00	0.95	0.8	
	ΔT	27	26	25	21	27	27	25	22	27	27	25	22	26	27	25	22	26	25	25	22	23	23	23	20	20
kW	1.98	2.03	2.09	2.2	2.14	2.19	2.27	2.3	2.29	2.34	2.42	2.5	2.41	2.47	2.55	2.6	2.52	2.58	2.66	2.8	2.61	2.67	2.76	2.9		
Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.8	10.1	10.5	10.2	10.5	10.8	11.2	10.9	11.2	11.5	12.0	11.5	11.8	12.2	12.7		
Hi PR	224	241	254	265.0	251	270	285	298.0	286	307	325	339.0	325	350	370	386.0	366	394	416	434.0	404	435	459	479.0		
Lo PR	109	116	127	135.0	115	123	134	143.0	120	127	139	148.0	126	134	146	156.0	132	140	153	163.0	136	145	158	169.0		
MBh	36.5	37.2	39.0	41.6	35.7	36.4	38.1	40.6	34.8	35.5	37.2	39.7	34.0	34.6	36.3	38.7	32.3	32.9	34.5	36.8	29.9	30.5	31.9	34.1		
S/T	1.00	0.96	0.87	0.7	1.00	1.00	0.90	0.7	1.00	1.00	0.92	0.8	1.00	1.00	0.95	0.8	1.00	1.00	0.99	0.8	1.00	1.00	1.00	0.8		
ΔT	25	24	23	20	24	25	23	20	24	24	23	20	23	24	24	20	23	24	24	20	20	21	22	19		
kW	2.00	2.04	2.11	2.2	2.16	2.21	2.29	2.4	2.30	2.36	2.44	2.5	2.43	2.49	2.57	2.7	2.54	2.60	2.69	2.8	2.63	2.69	2.79	2.9		
Amps	8.2	8.4	8.6	9.0	8.8	9.1	9.4	9.7	9.6	9.9	10.2	10.6	10.3	10.6	10.9	11.3	11.0	11.3	11.6	12.1	11.6	11.9	12.4	12.8		
Hi PR	226	243	257	268.0	254	273	288	301.0	288	310	328	342.0	329	354	373	389.0	370	398	420	438.0	408	439	464	484.0		
Lo PR	110	117	128	136.0	116	124	135	144.0	121	129	141	150.0	127	135	148	157.0	133	142	155	165.0	138	147	160	170.0		

kW = Total system power
Amps = outdoor unit amps

Shaded area reflects AHRI conditions

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	22.1	22.9	25.1	-	21.6	22.4	24.5	-	21.1	21.9	24.0	-	20.6	21.3	23.4	-	19.6	20.3	22.2	-	18.1	18.8	20.6	-
	S/T	0.72	0.60	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.83	0.69	0.48	-
	ΔT	19	16	12	-	19	16	12	-	19	16	13	-	19	17	13	-	19	16	12	-	18	15	12	-
	kW	1.29	1.31	1.35	-	1.38	1.41	1.45	-	1.46	1.50	1.54	-	1.54	1.57	1.62	-	1.60	1.63	1.68	-	1.65	1.69	1.74	-
	Amps	5.0	5.1	5.2	-	5.3	5.5	5.6	-	5.8	5.9	6.1	-	6.2	6.3	6.5	-	6.6	6.7	7.0	-	7.0	7.1	7.4	-
	Hi PR	201	217	229	-	226	243	257	-	257	277	292	-	293	315	333	-	329	354	374	-	364	392	413	-
	Lo PR	106	112	123	-	112	119	130	-	116	123	135	-	122	130	141	-	128	136	148	-	132	140	153	-
895	MBh	24.0	24.8	27.2	-	23.4	24.3	26.6	-	22.9	23.7	26.0	-	22.3	23.1	25.3	-	21.2	22.0	24.1	-	19.6	20.3	22.3	-
	S/T	0.75	0.62	0.43	-	0.77	0.65	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
	kW	1.32	1.35	1.39	-	1.42	1.44	1.49	-	1.50	1.53	1.58	-	1.57	1.61	1.66	-	1.64	1.67	1.73	-	1.69	1.73	1.79	-
	Amps	5.1	5.2	5.4	-	5.5	5.6	5.8	-	6.0	6.1	6.3	-	6.4	6.5	6.7	-	6.8	6.9	7.2	-	7.2	7.3	7.6	-
	Hi PR	208	223	236	-	233	251	265	-	265	285	301	-	302	325	343	-	339	365	386	-	375	404	426	-
	Lo PR	109	116	126	-	115	122	134	-	119	127	139	-	126	134	146	-	132	140	153	-	136	145	158	-
1000	MBh	24.3	25.2	27.6	-	23.8	24.6	27.0	-	23.2	24.0	26.3	-	22.6	23.5	25.7	-	21.5	22.3	24.4	-	19.9	20.6	22.6	-
	S/T	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.83	0.69	0.48	-	0.86	0.71	0.49	-	0.89	0.74	0.51	-	0.90	0.75	0.52	-
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
	kW	1.33	1.35	1.39	-	1.42	1.45	1.50	-	1.51	1.54	1.59	-	1.58	1.62	1.67	-	1.65	1.68	1.74	-	1.70	1.74	1.80	-
	Amps	5.1	5.2	5.4	-	5.5	5.7	5.8	-	6.0	6.1	6.3	-	6.4	6.6	6.8	-	6.8	7.0	7.2	-	7.2	7.4	7.6	-
	Hi PR	209	225	238	-	235	252	267	-	267	287	303	-	304	327	345	-	342	368	388	-	378	406	429	-
	Lo PR	110	117	127	-	116	123	134	-	120	128	140	-	126	134	147	-	132	141	154	-	137	146	159	-

75	MBh	22.5	23.2	25.1	26.9	22.0	22.6	24.5	26.3	21.5	22.1	23.9	25.7	20.9	21.6	23.3	25.0	19.9	20.5	22.2	23.8	18.4	19.0	20.5	22.0
	S/T	0.82	0.73	0.55	0.4	0.85	0.76	0.57	0.4	0.87	0.78	0.59	0.4	0.90	0.80	0.61	0.4	0.93	0.83	0.63	0.4	0.94	0.84	0.64	0.4
	ΔT	22	20	16	11	22	20	17	11	22	20	17	11	22	20	17	12	22	20	16	11	20	19	15	11
	kW	1.30	1.32	1.36	1.4	1.39	1.42	1.46	1.5	1.48	1.51	1.55	1.6	1.55	1.58	1.63	1.7	1.61	1.65	1.70	1.8	1.67	1.70	1.76	1.8
	Amps	5.0	5.1	5.3	5.5	5.4	5.5	5.7	5.9	5.8	6.0	6.2	6.4	6.2	6.4	6.6	6.8	6.6	6.8	7.0	7.3	7.0	7.2	7.4	7.7
	Hi PR	203	219	231	241	228	246	259	271	260	279	295	308	296	318	336	350	333	358	378	394	368	396	418	436
	Lo PR	107	113	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	159	133	142	155	165
895	MBh	24.4	25.1	27.2	29.2	23.8	24.5	26.5	28.5	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	21.5	22.2	24.0	25.8	20.0	20.5	22.2	23.9
	S/T	0.85	0.76	0.57	0.4	0.88	0.79	0.60	0.4	0.90	0.81	0.61	0.4	0.93	0.83	0.63	0.4	0.97	0.86	0.65	0.4	0.97	0.87	0.66	0.4
	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
	kW	1.33	1.36	1.40	1.4	1.43	1.46	1.50	1.6	1.51	1.54	1.59	1.6	1.59	1.62	1.67	1.7	1.65	1.69	1.74	1.8	1.71	1.74	1.80	1.9
	Amps	5.1	5.3	5.4	5.6	5.5	5.7	5.9	6.1	6.0	6.2	6.4	6.6	6.4	6.6	6.8	7.0	6.8	7.0	7.2	7.5	7.2	7.4	7.6	7.9
	Hi PR	210	226	238	249	235	253	267	279	268	288	304	317	305	328	346	361	343	369	390	406	379	408	431	449
	Lo PR	110	117	128	136	116	124	135	144	121	128	140	149	127	135	147	157	133	141	154	164	137	146	160	170
1000	MBh	24.7	25.5	27.6	29.6	24.2	24.9	26.9	28.9	23.6	24.3	26.3	28.2	23.0	23.7	25.7	27.5	21.9	22.5	24.4	26.2	20.3	20.9	22.6	24.2
	S/T	0.89	0.79	0.60	0.4	0.92	0.82	0.62	0.4	0.94	0.84	0.64	0.4	0.97	0.87	0.66	0.4	1.00	0.90	0.68	0.4	1.00	0.91	0.69	0.4
	ΔT	20	19	15	11	20	19	15	11	20	19	15	11	21	19	16	11	20	19	15	11	19	17	14	10
	kW	1.34	1.36	1.40	1.5	1.43	1.46	1.51	1.6	1.52	1.55	1.60	1.7	1.60	1.63	1.68	1.7	1.66	1.70	1.75	1.8	1.72	1.75	1.81	1.9
	Amps	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	6.0	6.2	6.4	6.6	6.5	6.6	6.8	7.1	6.9	7.0	7.3	7.5	7.3	7.4	7.7	8.0
	Hi PR	211	227	240	250	237	255	269	281	270	290	306	319	307	330	349	364	345	372	392	409	382	411	434	452
	Lo PR	111	118	129	137	117	124	136	145	122	129	141	150	128	136	148	158	134	142	155	166	138	147	161	171

IDB*: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 kW = Total system power
 Amps = outdoor unit amps

EXPANDED COOLING DATA — AVZC200361A* / CA*F3743*6D* + MBVC1600** -1A* + TXV (LOW STAGE)

IDB*		OUTDOOR AMBIENT TEMPERATURE																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		ENTERING INDOOR WET BULB TEMPERATURE																								
80	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
		MBh	22.9	23.4	25.0	26.7	22.4	22.9	24.4	26.1	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.2	20.7	22.1	23.6	18.7	19.2	20.5	21.9
		S/T	0.90	0.84	0.69	0.5	0.93	0.87	0.71	0.5	0.95	0.89	0.73	0.5	0.98	0.92	0.75	0.6	1.02	0.96	0.78	0.6	1.03	0.97	0.79	0.6
		ΔT	24	23	20	16	25	24	20	16	25	24	20	16	24	23	20	16	24	23	20	16	23	22	19	15
		kW	1.31	1.34	1.37	1.4	1.40	1.43	1.48	1.5	1.49	1.52	1.57	1.6	1.56	1.60	1.65	1.7	1.63	1.66	1.71	1.8	1.68	1.72	1.77	1.8
		Amps	5.0	5.2	5.3	5.5	5.4	5.6	5.7	6.0	5.9	6.0	6.2	6.5	6.3	6.4	6.7	6.9	6.7	6.9	7.1	7.4	7.1	7.3	7.5	7.8
		Hi/PR	205	221	234	244	231	248	262	273	262	282	298	311	299	321	339	354	336	362	382	398	371	400	422	440
Lo/PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	156	167		
895	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
		MBh	24.8	25.4	27.1	29.0	24.2	24.8	26.5	28.3	23.7	24.2	25.8	27.6	23.1	23.6	25.1	26.9	21.9	22.4	23.9	25.6	20.3	20.8	22.2	23.7
		S/T	0.93	0.87	0.71	0.5	0.96	0.90	0.74	0.6	0.99	0.93	0.76	0.6	1.00	0.96	0.78	0.6	1.00	0.99	0.81	0.6	1.00	1.00	0.82	0.6
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	23	23	20	16	21	21	19	15
		kW	1.34	1.37	1.41	1.5	1.44	1.47	1.51	1.6	1.52	1.56	1.60	1.7	1.60	1.63	1.69	1.7	1.67	1.70	1.76	1.8	1.72	1.76	1.82	1.9
		Amps	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	6.1	6.2	6.4	6.7	6.5	6.6	6.8	7.1	6.9	7.1	7.3	7.6	7.3	7.5	7.7	8.0
		Hi/PR	212	228	241	251	238	256	270	282	270	291	307	320	308	331	350	365	346	373	394	411	383	412	435	454
Lo/PR	111	118	129	137	117	125	136	145	122	130	142	151	128	136	149	158	134	143	156	166	139	148	161	172		
1000	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
		MBh	25.2	25.7	27.5	29.4	24.6	25.1	26.9	28.7	24.0	24.5	26.2	28.0	23.4	23.9	25.6	27.3	22.3	22.7	24.3	26.0	20.6	21.1	22.5	24.1
		S/T	0.97	0.91	0.74	0.6	1.00	0.94	0.77	0.6	1.00	0.97	0.79	0.6	1.00	1.00	0.81	0.6	1.00	1.00	0.84	0.6	1.00	1.00	0.85	0.6
		ΔT	23	22	19	15	23	22	19	15	22	22	19	15	22	22	19	15	22	21	19	15	19	19	18	14
		kW	1.35	1.37	1.41	1.5	1.45	1.47	1.52	1.6	1.53	1.56	1.61	1.7	1.61	1.64	1.70	1.8	1.67	1.71	1.77	1.8	1.73	1.77	1.83	1.9
		Amps	5.2	5.3	5.5	5.7	5.6	5.8	5.9	6.2	6.1	6.2	6.5	6.7	6.5	6.7	6.9	7.2	6.9	7.1	7.3	7.6	7.3	7.5	7.8	8.1
		Hi/PR	213	230	242	253	239	258	272	284	272	293	309	323	310	334	352	367	349	375	396	413	385	415	438	457
Lo/PR	112	119	130	138	118	126	137	146	123	131	143	152	129	137	150	160	135	144	157	167	140	149	162	173		

780	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
		MBh	23.3	23.8	24.9	26.5	22.8	23.2	24.3	25.9	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	20.6	21.0	22.0	23.5	19.1	19.4	20.4	21.7	
		S/T	0.94	0.91	0.82	0.7	0.98	0.94	0.85	0.7	1.00	0.96	0.87	0.7	1.00	1.00	0.90	0.7	1.00	1.00	0.93	0.8	1.00	1.00	0.94	0.8	
		ΔT	26	25	24	21	26	26	24	21	26	26	24	21	26	26	25	21	24	24	25	24	21	22	23	23	20
		kW	1.32	1.35	1.39	1.4	1.41	1.44	1.49	1.5	1.50	1.53	1.58	1.6	1.57	1.61	1.66	1.7	1.64	1.67	1.73	1.8	1.69	1.73	1.79	1.8	
		Amps	5.1	5.2	5.4	5.6	5.5	5.6	5.8	6.0	6.0	6.1	6.3	6.5	6.4	6.5	6.7	7.0	6.8	6.9	7.2	7.4	7.2	7.3	7.6	7.9	
		Hi/PR	208	223	236	246	233	251	265	276	265	285	301	314	302	325	343	358	339	365	386	402	375	404	426	444	
Lo/PR	109	116	126	135	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	163	136	145	158	168			
895	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
		MBh	25.2	25.7	27.0	28.8	24.7	25.1	26.3	28.1	24.1	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.3	22.7	23.8	25.4	20.7	21.1	22.1	23.5	
		S/T	0.98	0.94	0.85	0.7	1.00	0.98	0.88	0.7	1.00	1.00	0.90	0.7	1.00	1.00	0.93	0.8	1.00	1.00	0.97	0.8	1.00	1.00	0.98	0.8	
		ΔT	25	25	24	20	25	25	24	21	25	25	24	21	24	25	24	21	24	23	24	20	21	22	22	19	
		kW	1.35	1.38	1.42	1.5	1.45	1.48	1.52	1.6	1.54	1.57	1.62	1.7	1.61	1.65	1.70	1.8	1.68	1.71	1.77	1.8	1.74	1.77	1.83	1.9	
		Amps	5.2	5.3	5.5	5.7	5.6	5.8	6.0	6.2	6.1	6.3	6.5	6.7	6.5	6.7	6.9	7.2	6.9	7.1	7.4	7.6	7.4	7.5	7.8	8.1	
		Hi/PR	214	230	243	254	240	258	273	285	273	294	310	324	311	335	353	369	350	376	398	415	387	416	439	458	
Lo/PR	112	119	130	139	118	126	138	147	123	131	143	152	129	138	150	160	136	144	157	168	140	149	163	173			
1000	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
		MBh	25.6	26.1	27.4	29.2	25.0	25.5	26.7	28.5	24.4	24.9	26.1	27.8	23.8	24.3	25.5	27.2	22.6	23.1	24.2	25.8	21.0	21.4	22.4	23.9	
		S/T	1.00	0.98	0.89	0.7	1.00	1.00	0.92	0.8	1.00	1.00	0.94	0.8	1.00	1.00	0.97	0.8	1.00	1.00	0.97	0.8	1.00	1.00	0.98	0.8	
		ΔT	24	24	22	19	23	23	23	20	22	23	23	20	22	22	23	20	21	21	22	19	19	20	21	18	
		kW	1.36	1.38	1.43	1.5	1.46	1.49	1.53	1.6	1.54	1.58	1.63	1.7	1.62	1.66	1.71	1.8	1.69	1.72	1.78	1.8	1.75	1.78	1.84	1.9	
		Amps	5.3	5.4	5.6	5.8	5.7	5.8	6.0	6.2	6.2	6.3	6.5	6.8	6.6	6.7	7.0	7.2	7.0	7.2	7.4	7.7	7.4	7.6	7.8	8.1	
		Hi/PR	215	232	245	255	242	260	275	287	275	296	312	326	313	337	356	371	352	379	400	418	389	419	442	461	
Lo/PR	113	120	131	140	119	127	139	148	124	132	144	153	130	139	151	161	137	145	159	169	141	150	164	175			

kW = Total system power
Amps = outdoor unit amps

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — AVZC200481A*/CA*F4961*6D* + MBVC2000** -1A* +TXV (HIGH STAGE)

		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	43.6	45.2	49.5	-	42.6	44.1	48.3	-	41.5	43.1	47.2	-	40.5	42.0	46.0	-	38.5	39.9	43.7	-	35.7	37.0	40.5	-
	S/T	0.69	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-
	ΔT	21	18	14	-	21	19	14	-	21	19	14	-	22	19	14	-	21	18	14	-	20	17	13	-
	kW	2.71	2.76	2.85	-	2.92	2.98	3.08	-	3.11	3.18	3.29	-	3.28	3.35	3.46	-	3.42	3.50	3.62	-	3.54	3.62	3.75	-
	Amps	10.9	11.2	11.6	-	11.8	12.1	12.5	-	12.9	13.2	13.6	-	13.8	14.1	14.6	-	14.7	15.0	15.5	-	15.5	15.9	16.5	-
	Hi PR	219	236	249	-	246	264	279	-	279	301	318	-	318	343	362	-	358	385	407	-	396	426	450	-
	Lo PR	103	110	120	-	109	116	127	-	113	121	132	-	119	127	138	-	125	133	145	-	129	137	150	-
	MBh	44.2	45.9	50.2	-	43.2	44.8	49.1	-	42.2	43.7	47.9	-	41.2	42.7	46.7	-	39.1	40.5	44.4	-	36.2	37.5	41.1	-
	S/T	0.71	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	20	17	13	-	20	18	13	-	20	18	13	-	21	18	13	-	20	18	13	-	19	16	12	-
kW	2.74	2.80	2.90	-	2.96	3.03	3.13	-	3.15	3.23	3.33	-	3.32	3.40	3.52	-	3.47	3.55	3.67	-	3.59	3.68	3.80	-	
Amps	11.1	11.4	11.7	-	12.0	12.3	12.7	-	13.1	13.4	13.8	-	14.0	14.3	14.8	-	14.9	15.3	15.8	-	15.8	16.2	16.7	-	
Hi PR	223	240	253	-	250	269	284	-	284	306	323	-	324	348	368	-	364	392	414	-	403	433	457	-	
Lo PR	105	112	122	-	111	118	129	-	115	123	134	-	121	129	141	-	127	135	147	-	131	140	152	-	
MBh	44.7	46.3	50.7	-	43.6	45.2	49.6	-	42.6	44.2	48.4	-	41.6	43.1	47.2	-	39.5	40.9	44.8	-	36.6	37.9	41.5	-	
S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-	
ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	12	-	18	15	12	-	
kW	2.75	2.81	2.90	-	2.97	3.04	3.14	-	3.16	3.23	3.34	-	3.33	3.41	3.52	-	3.48	3.56	3.68	-	3.60	3.69	3.81	-	
Amps	11.1	11.4	11.8	-	12.0	12.3	12.8	-	13.1	13.4	13.9	-	14.0	14.4	14.9	-	14.9	15.3	15.8	-	15.8	16.2	16.8	-	
Hi PR	223	240	254	-	251	270	285	-	285	307	324	-	325	350	369	-	365	393	415	-	404	434	459	-	
Lo PR	105	112	122	-	111	118	129	-	116	123	134	-	121	129	141	-	127	135	148	-	132	140	153	-	
75	MBh	44.3	45.6	49.4	53.0	43.3	44.6	48.2	51.8	42.3	43.5	47.1	50.5	41.2	42.4	45.9	49.3	39.2	40.3	43.6	46.8	36.3	37.3	40.4	43.4
	S/T	0.78	0.70	0.53	0.3	0.81	0.72	0.55	0.4	0.83	0.74	0.56	0.4	0.86	0.77	0.58	0.4	0.89	0.79	0.60	0.4	0.89	0.80	0.61	0.4
	ΔT	24	23	18	13	25	23	19	13	25	23	19	13	25	23	19	13	25	23	19	13	23	21	17	12
	kW	2.73	2.79	2.88	3.0	2.94	3.01	3.11	3.2	3.14	3.21	3.31	3.4	3.31	3.38	3.49	3.6	3.45	3.53	3.65	3.8	3.57	3.65	3.78	3.9
	Amps	11.0	11.3	11.7	12.1	11.9	12.2	12.6	13.1	13.0	13.3	13.8	14.3	13.9	14.2	14.7	15.3	14.8	15.2	15.7	16.3	15.7	16.1	16.6	17.3
	Hi PR	221	238	251	262	248	267	282	294	282	304	321	335	322	346	365	381	362	389	411	429	400	430	454	474
	Lo PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161
	MBh	45.0	46.3	50.1	53.8	43.9	45.2	49.0	52.6	42.9	44.2	47.8	51.3	41.9	43.1	46.6	50.1	39.8	40.9	44.3	47.6	36.8	37.9	41.0	44.0
	S/T	0.81	0.72	0.55	0.4	0.84	0.75	0.57	0.4	0.86	0.77	0.58	0.4	0.89	0.79	0.60	0.4	0.92	0.82	0.62	0.4	0.93	0.83	0.63	0.4
	ΔT	23	21	18	12	24	22	18	12	24	22	18	12	24	22	18	12	23	22	18	12	22	20	16	11
kW	2.77	2.83	2.92	3.0	2.99	3.05	3.16	3.3	3.18	3.25	3.36	3.5	3.35	3.43	3.55	3.7	3.50	3.58	3.70	3.8	3.63	3.71	3.84	4.0	
Amps	11.2	11.5	11.9	12.3	12.1	12.4	12.8	13.3	13.2	13.5	14.0	14.5	14.1	14.5	15.0	15.5	15.0	15.4	15.9	16.6	15.9	16.3	16.9	17.6	
Hi PR	225	242	256	267	253	272	287	299	287	309	326	340	327	352	372	388	368	396	418	436	407	438	462	482	
Lo PR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	128	136	149	159	133	141	154	164	
MBh	45.4	46.8	50.6	54.3	44.4	45.7	49.5	53.1	43.3	44.6	48.3	51.8	42.3	43.5	47.1	50.6	40.2	41.3	44.8	48.0	37.2	38.3	41.5	44.5	
S/T	0.83	0.74	0.56	0.4	0.86	0.77	0.58	0.4	0.88	0.79	0.59	0.4	0.91	0.81	0.61	0.4	0.94	0.84	0.64	0.4	0.95	0.85	0.64	0.4	
ΔT	22	20	16	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	22	20	15	11	
kW	2.77	2.83	2.93	3.0	2.99	3.06	3.16	3.3	3.19	3.26	3.37	3.5	3.36	3.44	3.56	3.7	3.51	3.59	3.71	3.8	3.63	3.72	3.85	4.0	
Amps	11.2	11.5	11.9	12.3	12.2	12.5	12.9	13.4	13.2	13.6	14.0	14.6	14.2	14.5	15.0	15.6	15.1	15.5	16.0	16.6	16.0	16.4	17.0	17.6	
Hi PR	226	243	257	268	253	273	288	300	288	310	327	341	328	353	373	389	369	397	419	438	408	439	463	483	
Lo PR	106	113	124	132	112	120	131	139	117	124	136	144	123	131	142	152	129	137	149	159	133	141	154	165	

IDB*: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps

EXPANDED COOLING DATA — AVZC200481A* / CA*F4961*6D* + MBVC2000**-1A*+TXV (HIGH STAGE)

IDB*		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		ENTERING INDOOR WET BULB TEMPERATURE																							
AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
1300	MBh	45.1	46.1	49.2	52.6	44.1	45.0	48.1	51.4	43.0	43.9	46.9	50.2	42.0	42.9	45.8	49.0	39.9	40.7	43.5	46.5	36.9	37.7	40.3	43.1
	S/T	0.86	0.80	0.65	0.5	0.89	0.83	0.68	0.5	0.91	0.85	0.70	0.5	0.94	0.88	0.72	0.5	0.98	0.92	0.74	0.6	0.98	0.92	0.75	0.6
	ΔT	27	26	23	18	28	27	23	18	28	27	23	18	28	27	23	19	28	26	23	18	26	25	21	17
	kW	2.75	2.81	2.90	3.0	2.97	3.04	3.14	3.2	3.16	3.23	3.34	3.5	3.33	3.41	3.52	3.7	3.48	3.56	3.68	3.8	3.60	3.69	3.81	4.0
	Amps	11.1	11.4	11.8	12.2	12.0	12.3	12.8	13.2	13.1	13.4	13.9	14.4	14.0	14.4	14.9	15.4	14.9	15.3	15.8	16.4	15.8	16.2	16.8	17.4
	Hi/PR	223	240	254	265	251	270	285	297	285	307	324	338	325	350	369	385	365	393	415	433	404	434	459	479
Lo/PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	
80	MBh	45.8	46.8	50.0	53.4	44.7	45.7	48.8	52.2	43.7	44.6	47.7	51.0	42.6	43.5	46.5	49.7	40.5	41.3	44.2	47.2	37.5	38.3	40.9	43.7
	S/T	0.89	0.83	0.68	0.5	0.92	0.86	0.70	0.5	0.94	0.89	0.72	0.5	0.97	0.91	0.74	0.6	1.00	0.95	0.77	0.6	1.00	0.96	0.78	0.6
	ΔT	26	25	22	17	26	25	22	18	26	25	22	18	27	25	22	18	26	25	22	17	24	23	20	16
	kW	2.79	2.85	2.94	3.0	3.01	3.08	3.18	3.3	3.21	3.28	3.39	3.5	3.38	3.46	3.58	3.7	3.53	3.61	3.73	3.9	3.66	3.74	3.87	4.0
	Amps	11.3	11.6	12.0	12.4	12.2	12.5	13.0	13.5	13.3	13.6	14.1	14.6	14.2	14.6	15.1	15.7	15.2	15.6	16.1	16.7	16.1	16.5	17.1	17.7
	Hi/PR	227	245	258	269	255	275	290	302	290	312	330	344	330	356	376	392	372	400	422	441	411	442	467	487
Lo/PR	107	114	124	133	113	120	131	140	118	125	137	145	124	131	144	153	129	138	150	160	134	142	156	166	
1580	MBh	46.2	47.3	50.5	54.0	45.2	46.2	49.3	52.7	44.1	45.1	48.1	51.5	43.0	44.0	47.0	50.2	40.9	41.8	44.6	47.7	37.9	38.7	41.3	44.2
	S/T	0.91	0.85	0.69	0.5	0.94	0.88	0.72	0.5	0.96	0.90	0.74	0.6	1.00	0.93	0.76	0.6	1.00	0.97	0.79	0.6	1.00	0.98	0.79	0.6
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	24	24	20	16	22	22	19	15
	kW	2.80	2.86	2.95	3.1	3.02	3.09	3.19	3.3	3.22	3.29	3.40	3.5	3.39	3.47	3.59	3.7	3.54	3.62	3.74	3.9	3.67	3.75	3.88	4.0
	Amps	11.3	11.6	12.0	12.5	12.3	12.6	13.0	13.5	13.4	13.7	14.1	14.7	14.3	14.6	15.1	15.7	15.2	15.6	16.1	16.8	16.1	16.5	17.1	17.8
	Hi/PR	228	245	259	270	256	275	291	303	291	313	331	345	331	357	377	393	373	401	424	442	412	443	468	488
Lo/PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	

1300	MBh	45.9	46.8	49.0	52.3	44.8	45.7	47.9	51.1	43.8	44.6	46.7	49.8	42.7	43.5	45.6	48.6	40.6	41.3	43.3	46.2	37.6	38.3	40.1	42.8	
	S/T	0.90	0.87	0.78	0.6	0.93	0.90	0.81	0.7	0.95	0.92	0.83	0.7	0.99	0.95	0.86	0.7	1.00	0.99	0.89	0.7	1.00	1.00	0.90	0.7	
	ΔT	29	29	27	23	30	29	27	24	30	29	27	24	30	29	28	24	24	29	29	27	24	27	27	25	22
	kW	2.77	2.83	2.93	3.0	2.99	3.06	3.16	3.3	3.19	3.26	3.37	3.5	3.36	3.44	3.55	3.7	3.51	3.59	3.71	3.8	3.63	3.72	3.85	4.0	
	Amps	11.2	11.5	11.9	12.3	12.2	12.5	12.9	13.4	13.2	13.6	14.0	14.5	14.2	14.5	15.0	15.6	15.1	15.5	16.0	16.6	16.0	16.4	17.0	17.6	
	Hi/PR	226	243	256	268	253	273	288	300	288	310	327	341	328	353	373	389	369	397	419	437	408	439	463	483	
Lo/PR	106	113	124	132	112	120	131	139	117	124	136	144	123	131	142	152	129	137	149	159	133	141	154	164		
85	MBh	46.6	47.5	49.7	53.1	45.5	46.4	48.6	51.8	44.4	45.3	47.4	50.6	43.3	44.2	46.3	49.4	41.2	42.0	44.0	46.9	38.1	38.9	40.7	43.4	
	S/T	0.93	0.90	0.81	0.7	0.97	0.93	0.84	0.7	0.99	0.96	0.86	0.7	1.00	0.99	0.89	0.7	1.00	1.00	0.92	0.8	1.00	1.00	0.93	0.8	
	ΔT	28	27	26	22	28	28	26	23	28	28	26	23	28	28	26	23	28	26	27	26	22	24	25	24	21
	kW	2.81	2.87	2.97	3.1	3.04	3.11	3.21	3.3	3.24	3.31	3.42	3.5	3.41	3.49	3.61	3.7	3.56	3.64	3.77	3.9	3.69	3.77	3.90	4.0	
	Amps	11.4	11.7	12.1	12.5	12.4	12.7	13.1	13.6	13.4	13.8	14.2	14.8	14.4	14.7	15.2	15.8	15.3	15.7	16.2	16.9	16.3	16.7	17.2	17.9	
	Hi/PR	230	247	261	272	258	277	293	305	293	315	333	347	334	359	379	396	375	404	427	445	415	446	471	492	
Lo/PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167		
1580	MBh	47.1	48.0	50.2	53.6	46.0	46.8	49.1	52.3	44.9	45.7	47.9	51.1	43.8	44.6	46.7	49.9	41.6	42.4	44.4	47.4	38.5	39.3	41.1	43.9	
	S/T	0.95	0.92	0.83	0.7	0.98	0.95	0.86	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.94	0.8	1.00	1.00	0.95	0.8	
	ΔT	26	26	24	21	26	26	24	21	26	26	25	21	25	26	25	21	24	25	24	21	22	23	23	20	
	kW	2.82	2.88	2.98	3.1	3.05	3.11	3.22	3.3	3.24	3.32	3.43	3.6	3.42	3.50	3.62	3.7	3.57	3.65	3.78	3.9	3.70	3.78	3.91	4.1	
	Amps	11.4	11.7	12.1	12.6	12.4	12.7	13.1	13.6	13.5	13.8	14.3	14.8	14.4	14.8	15.3	15.9	15.4	15.7	16.3	16.9	16.3	16.7	17.3	17.9	
	Hi/PR	230	248	262	273	258	278	294	306	294	316	334	348	335	360	380	397	377	405	428	446	416	448	473	493	
Lo/PR	109	115	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168		

kW = Total system power
Amps = outdoor unit amps

Shaded area reflects AHRI conditions

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB*		OUTDOOR AMBIENT TEMPERATURE																									
		65°F					75°F					85°F				95°F				105°F				115°F			
		ENTERING INDOOR WET BULB TEMPERATURE																									
	AIRFLOW	59	63	67	71	71	59	63	67	71	71	59	63	67	71	71	59	63	67	71	71	59	63	67	71	71	
70	MBh	29.0	30.1	32.9	-	28.3	29.4	32.2	-	27.7	28.7	31.4	-	27.0	28.0	30.6	-	25.6	26.6	29.1	-	23.7	24.6	27.0	-		
	S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.44	-	0.80	0.67	0.46	-	0.80	0.67	0.47	-		
	ΔT	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	16	12	-		
	kW	1.79	1.83	1.88	-	1.92	1.96	2.01	-	2.03	2.07	2.13	-	2.13	2.17	2.24	-	2.21	2.26	2.33	-	2.28	2.33	2.40	-		
	Amps	6.8	7.0	7.2	-	7.3	7.5	7.7	-	7.9	8.1	8.4	-	8.5	8.7	8.9	-	9.0	9.2	9.5	-	9.5	9.7	10.1	-		
	Hi PR	209	225	237	-	234	252	266	-	266	287	303	-	303	326	345	-	341	367	388	-	377	406	429	-		
Lo PR	106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	148	-	132	141	154	-			
MBh	30.5	31.7	34.7	-	29.8	30.9	33.9	-	29.1	30.2	33.1	-	28.4	29.4	32.3	-	27.0	28.0	30.6	-	25.0	25.9	28.4	-			
S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-			
ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	12	-	18	15	12	-			
kW	1.82	1.85	1.91	-	1.95	1.99	2.04	-	2.06	2.10	2.17	-	2.16	2.20	2.27	-	2.24	2.29	2.36	-	2.32	2.37	2.44	-			
Amps	6.9	7.1	7.3	-	7.5	7.6	7.9	-	8.1	8.3	8.5	-	8.6	8.8	9.1	-	9.2	9.4	9.7	-	9.7	9.9	10.2	-			
Hi PR	213	229	242	-	239	257	272	-	272	293	309	-	310	333	352	-	348	375	396	-	385	414	437	-			
Lo PR	108	115	125	-	114	121	132	-	118	126	138	-	124	132	145	-	130	139	152	-	135	144	157	-			
MBh	31.5	32.6	35.7	-	30.7	31.8	34.9	-	30.0	31.1	34.1	-	29.3	30.3	33.2	-	27.8	28.8	31.6	-	25.7	26.7	29.2	-			
S/T	0.77	0.64	0.44	-	0.80	0.66	0.46	-	0.82	0.68	0.47	-	0.84	0.70	0.49	-	0.87	0.73	0.51	-	0.88	0.74	0.51	-			
ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	17	15	11	-	16	14	11	-			
kW	1.83	1.87	1.92	-	1.96	2.00	2.06	-	2.08	2.12	2.18	-	2.18	2.22	2.29	-	2.26	2.31	2.38	-	2.34	2.39	2.46	-			
Amps	7.0	7.1	7.4	-	7.5	7.7	7.9	-	8.2	8.3	8.6	-	8.7	8.9	9.2	-	9.2	9.5	9.8	-	9.8	10.0	10.3	-			
Hi PR	215	232	244	-	241	260	274	-	275	295	312	-	313	336	355	-	352	379	400	-	389	418	442	-			
Lo PR	109	116	127	-	115	123	134	-	120	127	139	-	126	134	146	-	132	140	153	-	136	145	158	-			

75	MBh	29.5	30.4	32.9	35.3	28.8	29.7	32.1	34.5	28.1	29.0	31.4	33.6	27.4	28.3	30.6	32.8	26.1	26.8	29.1	31.2	24.2	24.9	26.9	28.9	
	S/T	0.80	0.71	0.54	0.4	0.83	0.74	0.56	0.4	0.88	0.79	0.60	0.4	0.87	0.78	0.59	0.4	0.91	0.81	0.61	0.4	0.91	0.82	0.62	0.4	
	ΔT	22	20	17	11	22	21	17	12	22	21	17	12	23	21	17	12	22	22	20	17	12	21	19	16	11
	kW	1.80	1.84	1.89	2.0	1.93	1.97	2.03	2.1	2.04	2.09	2.15	2.2	2.14	2.19	2.25	2.3	2.23	2.27	2.34	2.4	2.30	2.35	2.42	2.5	
	Amps	6.9	7.0	7.2	7.5	7.4	7.6	7.8	8.1	8.0	8.2	8.5	8.8	8.5	8.7	9.0	9.4	9.1	9.3	9.6	9.9	9.6	9.8	10.2	10.5	
	Hi PR	211	227	240	250	237	255	269	280	269	290	306	319	306	330	348	363	345	371	392	409	381	410	433	452	
Lo PR	107	114	124	132	113	120	131	140	117	125	136	145	123	131	143	152	129	137	150	160	134	142	155	165		
MBh	31.1	32.0	34.6	37.1	30.3	31.2	33.8	36.3	29.6	30.5	33.0	35.4	28.9	29.7	32.2	34.6	27.4	28.3	30.6	32.8	25.4	26.2	28.3	30.4		
S/T	0.83	0.74	0.56	0.4	0.86	0.77	0.58	0.4	0.88	0.79	0.60	0.4	0.91	0.82	0.62	0.4	0.95	0.85	0.64	0.4	0.96	0.85	0.65	0.4		
ΔT	22	20	16	11	22	20	17	11	22	20	17	12	22	20	17	12	22	22	20	17	11	20	19	15	11	
kW	1.83	1.87	1.92	2.0	1.96	2.00	2.06	2.1	2.08	2.12	2.18	2.3	2.18	2.22	2.29	2.4	2.26	2.31	2.38	2.5	2.34	2.39	2.46	2.5		
Amps	7.0	7.1	7.4	7.6	7.5	7.7	7.9	8.2	8.2	8.3	8.6	8.9	8.7	8.9	9.2	9.5	9.2	9.5	9.8	10.1	9.8	10.0	10.3	10.7		
Hi PR	215	232	245	255	241	260	274	286	275	295	312	325	313	337	355	371	352	379	400	417	389	418	442	461		
Lo PR	109	116	127	135	115	123	134	142	120	127	139	148	126	134	146	156	132	140	153	163	136	145	158	169		
MBh	32.0	32.9	35.6	38.3	31.2	32.2	34.8	37.4	30.5	31.4	34.0	36.5	29.8	30.6	33.2	35.6	28.3	29.1	31.5	33.8	26.2	27.0	29.2	31.3		
S/T	0.87	0.78	0.59	0.4	0.90	0.81	0.61	0.4	0.93	0.83	0.63	0.4	0.96	0.86	0.65	0.4	0.99	0.89	0.67	0.4	1.00	0.90	0.68	0.4		
ΔT	20	18	15	10	20	19	15	11	20	19	15	11	20	19	15	11	20	19	15	11	19	17	14	10		
kW	1.84	1.88	1.94	2.0	1.98	2.02	2.08	2.1	2.09	2.13	2.20	2.3	2.19	2.24	2.31	2.4	2.28	2.33	2.40	2.5	2.36	2.41	2.48	2.6		
Amps	7.0	7.2	7.4	7.7	7.6	7.8	8.0	8.3	8.2	8.4	8.7	9.0	8.8	9.0	9.3	9.6	9.3	9.5	9.9	10.2	9.9	10.1	10.4	10.8		
Hi PR	217	234	247	258	244	262	277	289	277	298	315	329	316	340	359	374	355	382	404	421	393	423	446	465		
Lo PR	110	117	128	136	116	124	135	144	121	129	140	150	127	135	148	157	133	142	155	165	138	146	160	170		

kW = Total system power
Amps = outdoor unit amps

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — AVZC200481A* / CA*F4961*6D* + MBVC2000** -1A* +TXV (LOW STAGE)

IDB*	OUTDOOR AMBIENT TEMPERATURE																																					
	65°F						75°F						85°F						95°F						105°F						115°F							
	AIRFLOW			59			63			67			71			59			63			67			71			59			63			67			71	
80	MBh	30.0	30.7	32.8	35.0	38.0	31.5	33.7	36.0	30.1	30.8	32.9	35.2	29.4	30.0	32.1	34.3	27.9	28.5	30.5	32.6	26.5	27.1	29.0	31.0	24.6	25.1	26.8	28.7									
	S/T	0.87	0.82	0.67	0.5	0.91	0.85	0.69	0.5	0.93	0.87	0.71	0.5	0.96	0.90	0.73	0.6	1.00	0.93	0.76	0.6	1.00	0.93	0.76	0.6	1.00	0.94	0.77	0.6									
	ΔT	25	24	21	16	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	16	23	22	19	15									
	kW	1.82	1.85	1.91	2.0	1.95	1.99	2.04	2.1	2.06	2.10	2.17	2.2	2.16	2.20	2.27	2.3	2.24	2.29	2.36	2.4	2.32	2.37	2.44	2.5	2.32	2.37	2.44	2.5									
	Amps	6.9	7.1	7.3	7.6	7.5	7.6	7.9	8.2	8.1	8.3	8.5	8.8	8.6	8.8	9.1	9.4	9.2	9.4	9.7	10.0	9.7	9.9	10.2	10.6	9.7	9.9	10.2	10.6									
	Hi PR	213	229	242	252	239	257	272	283	272	293	309	322	310	333	352	367	348	375	396	413	385	414	437	456	385	414	437	456									
	Lo PR	108	115	125	133	114	121	132	141	118	126	138	147	124	132	145	154	130	139	152	161	135	144	157	167	135	144	157	167									
1090	MBh	31.6	32.3	34.5	36.9	30.9	31.5	33.7	36.0	30.1	30.8	32.9	35.2	29.4	30.0	32.1	34.3	27.9	28.5	30.5	32.6	25.9	26.5	28.4	30.2	25.9	26.4	28.2	30.2									
	S/T	0.91	0.86	0.70	0.5	0.95	0.89	0.72	0.5	0.97	0.91	0.74	0.6	1.00	0.94	0.76	0.6	1.00	0.97	0.79	0.6	1.00	0.97	0.79	0.6	1.00	0.98	0.80	0.6									
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	24	23	20	16	22	22	19	15	22	22	19	15									
	kW	1.85	1.88	1.94	2.0	1.98	2.02	2.08	2.1	2.09	2.13	2.20	2.3	2.19	2.24	2.31	2.4	2.28	2.33	2.40	2.5	2.36	2.41	2.48	2.6	2.36	2.41	2.48	2.6									
	Amps	7.0	7.2	7.4	7.7	7.6	7.8	8.0	8.3	8.2	8.4	8.7	9.0	8.8	9.0	9.3	9.6	9.3	9.5	9.9	10.2	9.9	10.1	10.4	10.8	9.9	10.1	10.4	10.8									
	Hi PR	217	234	247	258	244	262	277	289	277	298	315	329	316	340	359	374	355	382	404	421	393	423	446	465	393	423	446	465									
	Lo PR	110	117	128	136	116	124	135	144	121	129	140	150	127	135	148	157	133	142	155	165	138	146	160	170	138	146	160	170									
1280	MBh	32.6	33.3	35.5	38.0	31.8	32.5	34.7	37.1	31.0	31.7	33.9	36.2	30.3	30.9	33.1	35.3	28.8	29.4	31.4	33.6	26.7	27.2	29.1	31.1	26.7	27.2	29.1	31.1									
	S/T	0.96	0.90	0.73	0.6	1.00	0.93	0.76	0.6	1.00	0.95	0.78	0.6	1.00	1.00	0.80	0.6	1.00	1.00	0.83	0.6	1.00	1.00	0.83	0.6	1.00	1.00	0.84	0.6									
	ΔT	22	21	19	15	23	22	19	15	22	22	19	15	22	22	19	15	21	21	19	15	21	21	19	15	19	20	18	14									
	kW	1.86	1.90	1.95	2.0	1.99	2.03	2.09	2.2	2.11	2.15	2.22	2.3	2.21	2.26	2.33	2.4	2.30	2.35	2.42	2.5	2.37	2.42	2.50	2.6	2.37	2.42	2.50	2.6									
	Amps	7.1	7.3	7.5	7.8	7.7	7.8	8.1	8.4	8.3	8.5	8.8	9.1	8.9	9.1	9.4	9.7	9.4	9.6	9.9	10.3	10.0	10.2	10.5	10.9	10.0	10.2	10.5	10.9									
	Hi PR	220	236	249	260	246	265	280	292	280	301	318	332	319	343	363	378	359	386	408	425	397	427	451	470	397	427	451	470									
	Lo PR	111	118	129	138	118	125	136	145	122	130	142	151	128	136	149	159	134	143	156	166	139	148	162	172	139	148	162	172									

85	MBh	30.6	31.1	32.6	34.8	29.8	30.4	31.9	34.0	29.1	29.7	31.1	33.2	28.4	29.0	30.3	32.4	27.0	27.5	28.8	30.8	25.0	25.5	26.7	28.5	25.0	25.5	26.7	28.5
	S/T	0.92	0.88	0.80	0.7	0.95	0.92	0.83	0.7	0.97	0.94	0.85	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.92	0.7
	ΔT	26	26	24	21	27	26	25	21	27	26	25	21	27	26	25	22	25	26	25	21	23	24	23	20	23	24	23	20
	kW	1.83	1.87	1.92	2.0	1.96	2.00	2.06	2.1	2.08	2.12	2.18	2.3	2.18	2.22	2.29	2.4	2.26	2.31	2.38	2.5	2.34	2.39	2.46	2.5	2.34	2.39	2.46	2.5
	Amps	7.0	7.1	7.4	7.6	7.5	7.7	7.9	8.2	8.2	8.3	8.6	8.9	8.7	8.9	9.2	9.5	9.2	9.5	9.8	10.1	9.8	10.0	10.3	10.7	9.8	10.0	10.3	10.7
	Hi PR	215	232	244	255	241	260	274	286	275	295	312	325	313	336	355	371	352	379	400	417	389	418	442	461	389	418	442	461
	Lo PR	109	116	127	135	115	123	134	142	120	127	139	148	126	134	146	156	132	140	153	163	136	145	158	169	136	145	158	169
1090	MBh	32.2	32.8	34.3	36.6	31.4	32.0	33.5	35.8	30.7	31.3	32.7	34.9	29.9	30.5	31.9	34.1	28.4	29.0	30.3	32.4	26.3	26.8	28.1	30.0	26.3	26.8	28.1	30.0
	S/T	0.96	0.92	0.83	0.7	0.99	0.96	0.86	0.7	1.00	0.98	0.89	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.95	0.8	1.00	1.00	0.95	0.8	1.00	1.00	0.96	0.8
	ΔT	26	26	24	21	26	26	24	21	26	26	24	21	25	26	25	21	24	24	24	21	22	23	23	20	22	23	23	20
	kW	1.86	1.90	1.95	2.0	1.99	2.03	2.09	2.2	2.11	2.15	2.22	2.3	2.21	2.26	2.33	2.4	2.30	2.35	2.42	2.5	2.37	2.42	2.50	2.6	2.37	2.42	2.50	2.6
	Amps	7.1	7.3	7.5	7.8	7.7	7.8	8.1	8.4	8.3	8.5	8.8	9.1	8.9	9.1	9.4	9.7	9.4	9.6	9.9	10.3	10.0	10.2	10.5	10.9	10.0	10.2	10.5	10.9
	Hi PR	220	236	249	260	246	265	280	292	280	301	318	332	319	343	363	378	359	386	408	425	397	427	451	470	397	427	451	470
	Lo PR	111	118	129	138	118	125	136	145	122	130	142	151	128	136	149	159	134	143	156	166	139	148	162	172	139	148	162	172
1280	MBh	33.1	33.8	35.4	37.7	32.4	33.0	34.5	36.9	31.6	32.2	33.7	36.0	30.8	31.4	32.9	35.1	29.3	29.8	31.3	33.3	27.1	27.6	28.9	30.9	27.1	27.6	28.9	30.9
	S/T	1.00	0.97	0.87	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.93	0.8	1.00	1.00	0.96	0.8	1.00	1.00	0.99	0.8	1.00	1.00	0.99	0.8	1.00	1.00	1.00	0.8
	ΔT	24	23	22	19	23	24	22	19	23	23	22	19	22	23	20	20	21	21	22	19	21	21	18	19	20	21	18	
	kW	1.87	1.91	1.97	2.0	2.01	2.05	2.11	2.2	2.12	2.17	2.23	2.3	2.23	2.27	2.34	2.4	2.32	2.37	2.44	2.5	2.39	2.44	2.52	2.6	2.39	2.44	2.52	2.6
	Amps	7.2	7.3	7.6	7.8	7.7	7.9	8.2	8.5	8.4	8.6	8.8	9.2	8.9	9.1	9.4	9.8	9.5	9.7	10.0	10.4	10.0	10.3	10.6	11.0	10.0	10.3	10.6	11.0
	Hi PR	222	239	252	263	249	268	283	295	283	304	322	335	322	347	366	382	363	390	412	430	401	431	455	475	401	431	455	475
	Lo PR	112	120	130	139	119	126	138	147	123	131	143	153	130	138	150	160	136	144	158	168	140	149	163	174	140	149	163	174

kW = Total system power
Amps = outdoor unit amps

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

		OUTDOOR AMBIENT TEMPERATURE												105°F												115°F											
		65°F				75°F				85°F				95°F				105°F				115°F															
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71												
70	MBh	49.2	51.0	55.9	-	48.1	49.8	54.6	-	46.9	48.6	53.3	-	45.8	47.4	52.0	-	43.5	45.1	49.4	-	29.7	30.8	33.7	-												
	S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.86	0.72	0.50	-												
	ΔT	21	18	14	-	21	19	14	-	21	19	14	-	22	19	14	-	20	18	14	-	16	14	10	-												
	kW	3.20	3.26	3.37	-	3.44	3.52	3.63	-	3.66	3.74	3.86	-	3.85	3.94	4.07	-	4.02	4.11	4.24	-	2.57	2.63	2.70	-												
	Amps	12.5	12.8	13.3	-	13.6	13.9	14.4	-	14.8	15.1	15.6	-	15.8	16.2	16.7	-	16.8	17.3	17.8	-	10.3	10.5	10.9	-												
	Hi PR	219	235	249	-	245	264	279	-	279	300	317	-	318	342	361	-	358	385	406	-	369	397	419	-												
	Lo PR	102	108	118	-	107	114	125	-	111	119	129	-	117	125	136	-	123	131	143	-	137	145	159	-												
	MBh	49.9	51.8	56.7	-	48.8	50.6	55.4	-	47.6	49.4	54.1	-	46.5	48.2	52.8	-	44.1	45.7	50.1	-	30.1	31.2	34.2	-												
	S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.89	0.74	0.52	-												
	ΔT	20	17	13	-	20	18	13	-	20	18	13	-	21	18	13	-	20	18	13	-	15	13	10	-												
	kW	3.24	3.31	3.41	-	3.49	3.57	3.68	-	3.71	3.80	3.92	-	3.91	4.00	4.13	-	4.08	4.17	4.31	-	2.61	2.66	2.74	-												
	Amps	12.7	13.0	13.5	-	13.8	14.1	14.6	-	15.0	15.4	15.9	-	16.1	16.5	17.0	-	17.1	17.5	18.1	-	10.5	10.7	11.1	-												
Hi PR	222	239	253	-	250	269	284	-	284	306	323	-	323	348	368	-	364	392	413	-	375	404	426	-													
Lo PR	103	110	120	-	109	116	127	-	113	121	132	-	119	127	138	-	125	133	145	-	139	148	161	-													
MBh	50.7	52.5	57.6	-	49.5	51.3	56.2	-	48.3	50.1	54.9	-	47.2	48.9	53.6	-	44.8	46.4	50.9	-	30.6	31.7	34.7	-													
S/T	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.81	0.67	0.47	-	0.83	0.70	0.48	-	0.86	0.72	0.50	-	0.93	0.78	0.54	-													
ΔT	19	17	13	-	19	17	13	-	19	17	13	-	20	17	13	-	19	17	13	-	14	12	9	-													
kW	3.26	3.33	3.43	-	3.51	3.59	3.70	-	3.73	3.82	3.94	-	3.93	4.02	4.15	-	4.10	4.19	4.33	-	2.62	2.67	2.75	-													
Amps	12.8	13.1	13.6	-	13.9	14.2	14.7	-	15.1	15.5	16.0	-	16.2	16.6	17.1	-	17.2	17.7	18.3	-	10.5	10.8	11.1	-													
Hi PR	224	241	255	-	251	271	286	-	286	308	325	-	326	350	370	-	366	394	416	-	378	407	429	-													
Lo PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	139	-	126	134	146	-	140	149	163	-													
75	MBh	50.0	51.5	55.8	59.8	48.9	50.3	54.5	58.5	47.7	49.1	53.2	57.1	46.5	47.9	51.9	55.7	44.2	45.5	49.3	52.9	30.2	31.1	33.6	36.1												
	S/T	0.80	0.71	0.54	0.4	0.83	0.74	0.56	0.4	0.85	0.76	0.57	0.4	0.87	0.78	0.59	0.4	0.91	0.81	0.61	0.4	0.98	0.87	0.66	0.4												
	ΔT	24	23	18	13	25	23	19	13	25	23	19	13	25	23	19	13	25	23	19	13	18	17	14	9												
	kW	3.22	3.29	3.39	3.5	3.47	3.55	3.66	3.8	3.69	3.77	3.90	4.0	3.89	3.97	4.10	4.2	4.05	4.14	4.28	4.4	2.59	2.65	2.73	2.8												
	Amps	12.7	13.0	13.4	13.9	13.7	14.0	14.5	15.1	14.9	15.3	15.8	16.4	16.0	16.4	16.9	17.6	17.0	17.4	18.0	18.7	10.4	10.6	11.0	11.4												
	Hi PR	221	238	251	262	248	267	282	294	282	303	320	334	321	346	365	381	361	389	411	428	373	401	423	442												
	Lo PR	103	109	119	127	108	115	126	134	113	120	131	139	118	126	137	146	124	132	144	153	138	147	160	171												
	MBh	50.8	52.3	56.6	60.8	49.6	51.1	55.3	59.3	48.4	49.9	54.0	57.9	47.3	48.6	52.7	56.5	44.9	46.2	50.0	53.7	30.7	31.6	34.2	36.7												
	S/T	0.83	0.74	0.56	0.4	0.86	0.77	0.58	0.4	0.88	0.79	0.59	0.4	0.91	0.81	0.61	0.4	0.94	0.84	0.64	0.4	1.00	0.91	0.69	0.4												
	ΔT	23	21	18	12	24	22	18	12	24	22	18	12	24	22	18	12	23	22	18	12	17	16	13	9												
	kW	3.27	3.34	3.44	3.6	3.52	3.60	3.71	3.8	3.74	3.83	3.95	4.1	3.94	4.03	4.16	4.3	4.11	4.20	4.34	4.5	2.63	2.68	2.76	2.9												
	Amps	12.9	13.2	13.6	14.1	13.9	14.3	14.7	15.3	15.1	15.5	16.1	16.7	16.2	16.6	17.2	17.8	17.3	17.7	18.3	19.0	10.6	10.8	11.2	11.6												
Hi PR	225	242	255	266	252	271	287	299	287	309	326	340	327	352	371	387	368	396	418	436	379	408	431	449													
Lo PR	104	111	121	129	110	117	128	136	115	122	133	142	120	128	140	149	126	134	146	156	140	149	163	174													
MBh	51.6	53.1	57.5	61.7	50.4	51.8	56.1	60.2	49.2	50.6	54.8	58.8	48.0	49.4	53.4	57.4	45.6	46.9	50.8	54.5	31.1	32.0	34.7	37.2													
S/T	0.86	0.77	0.58	0.4	0.89	0.80	0.61	0.4	0.92	0.82	0.62	0.4	0.95	0.85	0.64	0.4	0.98	0.88	0.67	0.4	1.00	0.95	0.72	0.5													
ΔT	22	20	17	12	23	21	17	12	23	21	17	12	23	21	17	12	22	21	17	12	16	15	12	9													
kW	3.28	3.36	3.46	3.6	3.54	3.62	3.74	3.9	3.77	3.85	3.98	4.1	3.97	4.05	4.19	4.3	4.14	4.23	4.37	4.5	2.64	2.70	2.78	2.9													
Amps	12.9	13.3	13.7	14.2	14.0	14.4	14.8	15.4	15.2	15.6	16.2	16.8	16.3	16.7	17.3	18.0	17.4	17.8	18.4	19.1	10.6	10.9	11.2	11.6													
Hi PR	226	244	257	268	254	273	289	301	289	311	328	342	329	354	374	390	370	398	421	439	382	411	434	452													
Lo PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	148	157	141	150	164	175													

IDB* - Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TYA) conditions
 kW = Total system power
 Amps = outdoor unit amps

EXPANDED COOLING DATA — AVZC200601A* / CA*F4961*6D* + MBVC2000**-1A*+TXV (HIGH STAGE)

		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		ENTERING INDOOR WET BULB TEMPERATURE																							
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	50.9	52.0	55.6	59.4	49.7	50.8	54.3	58.0	48.6	49.6	53.0	56.7	47.4	48.4	51.7	55.3	45.0	46.0	49.1	52.5	30.7	31.4	33.5	35.9
	S/T	0.87	0.82	0.67	0.5	0.91	0.85	0.69	0.5	0.93	0.87	0.71	0.5	0.96	0.90	0.73	0.6	1.00	0.93	0.76	0.6	1.00	1.01	0.82	0.6
	ΔT	27	26	23	18	28	26	23	18	28	26	23	18	28	27	23	19	27	26	23	18	19	19	17	13
	kW	3.25	3.32	3.42	3.5	3.50	3.58	3.69	3.8	3.72	3.80	3.93	4.1	3.92	4.01	4.14	4.3	4.09	4.18	4.32	4.5	2.61	2.67	2.75	2.8
	Amps	12.8	13.1	13.5	14.0	13.8	14.2	14.6	15.2	15.0	15.4	15.9	16.6	16.1	16.5	17.1	17.7	17.2	17.6	18.2	18.9	10.5	10.7	11.1	11.5
	Hi PR	223	240	254	265	250	269	285	297	285	306	324	338	324	349	369	384	365	393	415	433	376	405	428	446
	Lo PR	104	110	120	128	109	116	127	135	114	121	132	141	120	127	139	148	125	133	145	155	139	148	162	172
80	MBh	51.7	52.8	56.4	60.3	50.5	51.6	55.1	58.9	49.3	50.4	53.8	57.5	48.1	49.1	52.5	56.1	45.7	46.7	49.9	53.3	31.2	31.9	34.1	36.4
	S/T	0.91	0.85	0.69	0.5	0.94	0.88	0.72	0.5	0.96	0.90	0.74	0.6	0.99	0.93	0.76	0.6	1.00	0.97	0.79	0.6	1.00	1.00	0.85	0.6
	ΔT	26	25	22	17	26	25	22	17	26	25	22	18	26	25	22	18	25	25	22	17	17	18	16	13
	kW	3.29	3.36	3.47	3.6	3.55	3.63	3.74	3.9	3.78	3.86	3.99	4.1	3.98	4.06	4.20	4.3	4.15	4.24	4.38	4.5	2.65	2.70	2.78	2.9
	Amps	13.0	13.3	13.7	14.3	14.0	14.4	14.9	15.4	15.3	15.7	16.2	16.8	16.4	16.8	17.3	18.0	17.4	17.9	18.5	19.2	10.6	10.9	11.3	11.7
	Hi PR	227	244	258	269	255	274	290	302	290	312	329	343	330	355	375	391	371	400	422	440	383	412	435	454
	Lo PR	105	112	122	130	111	118	129	138	116	123	134	143	122	129	141	150	127	136	148	158	142	151	165	175
1840	MBh	52.5	53.6	57.3	61.2	51.3	52.4	56.0	59.8	50.0	51.1	54.6	58.4	48.8	49.9	53.3	57.0	46.4	47.4	50.6	54.1	31.7	32.4	34.6	37.0
	S/T	0.95	0.89	0.72	0.5	0.98	0.92	0.75	0.6	1.00	0.94	0.77	0.6	1.00	0.97	0.79	0.6	1.00	1.00	0.82	0.6	1.00	1.00	0.89	0.7
	ΔT	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	17	23	24	21	17	16	16	15	12
	kW	3.31	3.38	3.49	3.6	3.57	3.65	3.77	3.9	3.80	3.88	4.01	4.1	4.00	4.09	4.22	4.4	4.17	4.26	4.41	4.6	2.66	2.72	2.80	2.9
	Amps	13.1	13.4	13.8	14.4	14.1	14.5	15.0	15.5	15.4	15.8	16.3	16.9	16.5	16.9	17.5	18.1	17.6	18.0	18.6	19.3	10.7	11.0	11.3	11.8
	Hi PR	229	246	260	271	257	276	292	304	292	314	332	346	332	358	378	394	374	402	425	443	386	415	438	457
	Lo PR	106	113	123	131	112	119	130	139	117	124	135	144	122	130	142	151	128	136	149	159	143	152	166	177

1500	MBh	51.8	52.8	55.3	59.0	50.6	51.6	54.0	57.6	49.4	50.4	52.7	56.3	48.2	49.1	51.5	54.9	45.8	46.7	48.9	52.1	31.3	31.9	33.4	35.6	
	S/T	0.92	0.88	0.80	0.7	0.95	0.92	0.83	0.7	0.97	0.94	0.85	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.98	0.8	
	ΔT	29	29	27	23	29	29	27	24	29	29	27	24	30	29	28	24	24	28	29	27	24	19	20	20	17
	kW	3.27	3.34	3.45	3.6	3.53	3.61	3.72	3.9	3.75	3.84	3.96	4.1	3.95	4.04	4.17	4.3	4.12	4.21	4.35	4.5	2.63	2.69	2.77	2.9	
	Amps	12.9	13.2	13.6	14.2	14.0	14.3	14.8	15.3	15.2	15.6	16.1	16.7	16.3	16.7	17.2	17.9	17.3	17.8	18.4	19.1	10.6	10.8	11.2	11.6	
	Hi PR	225	243	256	267	253	272	287	300	288	310	327	341	328	353	372	388	369	397	419	437	380	409	432	451	
	Lo PR	105	111	122	129	111	118	128	137	115	122	133	142	121	128	140	149	126	135	147	156	141	150	164	174	
85	MBh	52.6	53.6	56.2	59.9	51.4	52.4	54.8	58.5	50.2	51.1	53.5	57.1	48.9	49.9	52.2	55.7	46.5	47.4	49.6	52.9	31.7	32.4	33.9	36.2	
	S/T	0.95	0.92	0.83	0.7	0.98	0.95	0.86	0.7	1.00	0.97	0.88	0.7	1.00	1.00	0.91	0.7	1.00	1.00	0.94	0.8	1.00	1.00	1.00	0.8	
	ΔT	28	27	26	22	28	28	26	23	28	28	26	23	27	28	26	23	26	26	26	22	18	18	19	16	
	kW	3.32	3.39	3.50	3.6	3.58	3.66	3.78	3.9	3.81	3.89	4.02	4.2	4.01	4.10	4.24	4.4	4.18	4.28	4.42	4.6	2.67	2.72	2.80	2.9	
	Amps	13.1	13.4	13.9	14.4	14.2	14.5	15.0	15.6	15.4	15.8	16.4	17.0	16.5	16.9	17.5	18.2	17.6	18.0	18.7	19.4	10.7	11.0	11.4	11.8	
	Hi PR	229	247	261	272	257	277	292	305	293	315	333	347	333	359	379	395	375	404	426	444	387	416	439	458	
	Lo PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	143	152	166	177	
1840	MBh	53.4	54.4	57.0	60.8	52.1	53.2	55.7	59.4	50.9	51.9	54.3	58.0	49.7	50.6	53.0	56.6	47.2	48.1	50.4	53.7	32.2	32.8	34.4	36.7	
	S/T	0.99	0.96	0.86	0.7	1.00	0.99	0.90	0.7	1.00	1.00	0.92	0.8	1.00	1.00	0.95	0.8	1.00	1.00	0.98	0.8	1.00	1.00	1.00	0.9	
	ΔT	26	26	25	21	26	26	25	22	25	26	25	22	25	25	25	22	24	24	25	21	16	16	17	16	
	kW	3.34	3.41	3.52	3.6	3.60	3.68	3.80	3.9	3.83	3.91	4.04	4.2	4.03	4.12	4.26	4.4	4.21	4.30	4.45	4.6	2.68	2.74	2.82	2.9	
	Amps	13.2	13.5	14.0	14.5	14.3	14.6	15.1	15.7	15.5	15.9	16.5	17.1	16.6	17.0	17.6	18.3	17.7	18.2	18.8	19.5	10.8	11.1	11.4	11.9	
	Hi PR	231	248	262	274	259	279	294	307	295	317	335	349	336	361	381	398	378	406	429	448	389	419	442	462	
	Lo PR	107	114	125	133	113	120	132	140	118	125	137	146	124	132	144	153	130	138	151	160	144	154	168	178	

kW = Total system power
Amps = outdoor unit amps

Shaded area reflects AHRI conditions

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — AVZC200601A* / CA*F4961*6D* + MBVC2000** -1A* + TXV (LOW STAGE)

		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1050	MBh	31.8	33.0	36.1	-	31.1	32.2	35.3	-	30.3	31.4	34.4	-	29.6	30.7	33.6	-	28.1	29.1	31.9	-	26.0	27.0	29.6	-
		S/T	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.66	0.45	-	0.81	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	18	13	-	20	17	13	-	19	16	12	-	
	kW	1.98	2.01	2.07	-	2.11	2.15	2.21	-	2.22	2.26	2.33	-	2.32	2.37	2.44	-	2.41	2.46	2.53	-	2.48	2.53	2.61	-	
	Amps	7.0	7.2	7.4	-	7.6	7.8	8.0	-	8.2	8.4	8.7	-	8.8	9.0	9.2	-	9.3	9.5	9.8	-	9.8	10.1	10.4	-	
	Hi PR	208	224	237	-	234	252	266	-	266	286	302	-	303	326	344	-	341	367	387	-	377	405	428	-	
	Lo PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	139	-	126	134	146	-	130	138	151	-	
	MBh	33.5	34.7	38.0	-	32.7	33.9	37.1	-	31.9	33.1	36.3	-	31.2	32.3	35.4	-	29.6	30.7	33.6	-	27.4	28.4	31.1	-	
	S/T	0.75	0.62	0.43	-	0.77	0.65	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-	
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
kW	2.01	2.04	2.10	-	2.14	2.18	2.24	-	2.25	2.30	2.36	-	2.36	2.40	2.47	-	2.44	2.49	2.57	-	2.52	2.57	2.65	-		
Amps	7.2	7.3	7.6	-	7.7	7.9	8.1	-	8.4	8.6	8.8	-	8.9	9.1	9.4	-	9.5	9.7	10.0	-	10.0	10.3	10.6	-		
Hi PR	213	229	242	-	239	257	271	-	271	292	308	-	309	333	351	-	348	374	395	-	384	414	437	-		
Lo PR	106	113	123	-	112	119	130	-	117	124	135	-	122	130	142	-	128	137	149	-	133	141	154	-		
MBh	34.5	35.8	39.2	-	33.7	34.9	38.3	-	32.9	34.1	37.3	-	32.1	33.3	36.4	-	30.5	31.6	34.6	-	28.2	29.3	32.1	-		
S/T	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.89	0.74	0.52	-	0.90	0.75	0.52	-		
ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-		
kW	2.02	2.06	2.11	-	2.15	2.19	2.25	-	2.27	2.31	2.38	-	2.37	2.42	2.49	-	2.46	2.51	2.58	-	2.54	2.59	2.67	-		
Amps	7.2	7.4	7.6	-	7.8	8.0	8.2	-	8.4	8.6	8.9	-	9.0	9.2	9.5	-	9.6	9.8	10.1	-	10.1	10.3	10.7	-		
Hi PR	215	231	244	-	241	259	274	-	274	295	312	-	312	336	355	-	351	378	399	-	388	418	441	-		
Lo PR	107	114	125	-	113	121	132	-	118	125	137	-	124	132	144	-	130	138	151	-	134	143	156	-		
75	1050	MBh	32.4	33.3	36.1	38.7	31.6	32.5	35.2	37.8	30.8	31.8	34.4	36.9	30.1	31.0	33.5	36.0	28.6	29.4	31.9	34.2	26.5	27.3	29.5	31.7
		S/T	0.81	0.73	0.55	0.4	0.84	0.75	0.57	0.4	0.86	0.77	0.58	0.4	0.89	0.80	0.60	0.4	0.93	0.83	0.63	0.4	0.93	0.83	0.63	0.4
	ΔT	23	21	17	12	23	21	18	12	23	21	18	12	24	22	18	12	23	21	17	12	22	20	16	11	
	kW	1.99	2.03	2.08	2.1	2.12	2.16	2.22	2.3	2.24	2.28	2.35	2.4	2.34	2.39	2.45	2.5	2.43	2.47	2.55	2.6	2.50	2.55	2.63	2.7	
	Amps	7.1	7.3	7.5	7.8	7.7	7.8	8.1	8.4	8.3	8.5	8.8	9.1	8.8	9.0	9.3	9.7	9.4	9.6	9.9	10.3	9.9	10.2	10.5	10.9	
	Hi PR	211	227	239	250	236	254	269	280	269	289	305	319	306	329	348	363	344	371	391	408	380	409	432	451	
	Lo PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	148	157	131	140	153	163	
	MBh	34.1	35.1	38.0	40.7	33.3	34.2	37.1	39.8	32.5	33.4	36.2	38.8	31.7	32.6	35.3	37.9	30.1	31.0	33.5	36.0	27.9	28.7	31.1	33.3	
	S/T	0.85	0.76	0.57	0.4	0.88	0.79	0.60	0.4	0.90	0.81	0.61	0.4	0.93	0.83	0.63	0.4	0.97	0.86	0.65	0.4	0.97	0.87	0.66	0.4	
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
kW	2.02	2.06	2.11	2.2	2.15	2.19	2.25	2.3	2.27	2.31	2.38	2.5	2.37	2.42	2.49	2.6	2.46	2.51	2.59	2.7	2.54	2.59	2.67	2.8		
Amps	7.2	7.4	7.6	7.9	7.8	8.0	8.2	8.5	8.4	8.6	8.9	9.2	9.0	9.2	9.5	9.9	9.6	9.8	10.1	10.5	10.1	10.3	10.7	11.1		
Hi PR	215	231	244	255	241	259	274	286	274	295	312	325	312	336	355	370	351	378	399	416	388	418	441	460		
Lo PR	107	114	125	133	113	121	132	140	118	125	137	146	124	132	144	153	130	138	151	160	134	143	156	166		
MBh	35.1	36.1	39.1	42.0	34.3	35.3	38.2	41.0	33.4	34.4	37.3	40.0	32.6	33.6	36.4	39.0	31.0	31.9	34.5	37.1	28.7	29.6	32.0	34.3		
S/T	0.89	0.80	0.60	0.4	0.92	0.82	0.62	0.4	0.95	0.85	0.64	0.4	0.98	0.87	0.66	0.4	1.00	0.91	0.69	0.4	1.00	0.91	0.69	0.4		
ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	18	15	10		
kW	2.03	2.07	2.13	2.2	2.17	2.21	2.27	2.3	2.29	2.33	2.40	2.5	2.39	2.44	2.51	2.6	2.48	2.53	2.60	2.7	2.56	2.61	2.69	2.8		
Amps	7.3	7.5	7.7	8.0	7.9	8.0	8.3	8.6	8.5	8.7	9.0	9.3	9.1	9.3	9.6	9.9	9.6	9.9	10.2	10.6	10.2	10.4	10.8	11.2		
Hi PR	217	234	247	257	244	262	277	289	277	298	315	328	315	339	358	374	355	382	403	421	392	422	446	465		
Lo PR	108	115	126	134	114	122	133	142	119	127	138	147	125	133	145	155	131	139	152	162	135	144	157	168		

IDB*: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 kW = Total system power
 Amps = outdoor unit amps

IDB*	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																									
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
80	1050	MBh	32.9	33.6	35.9	38.4	32.2	32.9	35.1	37.5	31.4	32.1	34.3	36.6	30.6	31.3	33.4	35.7	29.1	29.7	31.8	34.0	27.0	27.5	29.4	31.5	
		S/T	0.89	0.84	0.68	0.5	0.92	0.87	0.71	0.5	0.95	0.89	0.72	0.5	0.98	0.92	0.75	0.6	1.02	0.95	0.77	0.6	1.02	0.96	0.78	0.6	
	1180	ΔT	26	25	21	17	26	25	22	17	26	25	22	17	26	25	22	17	26	25	22	17	24	23	20	16	
		kW	2.01	2.04	2.10	2.2	2.14	2.18	2.24	2.3	2.25	2.30	2.36	2.4	2.36	2.40	2.47	2.6	2.44	2.49	2.57	2.6	2.52	2.57	2.65	2.7	
	1350	Amps	7.2	7.3	7.6	7.8	7.7	7.9	8.1	8.4	8.4	8.6	8.8	9.1	8.9	9.1	9.4	9.8	9.5	9.7	10.0	10.4	10.0	10.3	10.6	11.0	
		Hi PR	213	229	242	252	239	257	271	283	271	292	308	322	309	333	351	366	348	374	395	412	384	414	437	455	
	85	1050	Lo PR	106	113	123	131	112	119	130	139	117	124	135	144	122	130	142	151	128	137	149	159	133	141	154	164
			MBh	34.7	35.4	37.8	40.5	33.9	34.6	37.0	39.5	33.0	33.8	36.1	38.6	32.2	32.9	35.2	37.6	30.6	31.3	33.4	35.7	28.4	29.0	31.0	33.1
		1180	S/T	0.93	0.87	0.71	0.5	0.96	0.90	0.74	0.6	0.99	0.93	0.76	0.6	1.00	0.96	0.78	0.6	1.00	0.99	0.81	0.6	1.00	1.00	0.82	0.6
			ΔT	25	24	21	17	25	24	21	17	25	24	21	17	25	25	21	17	24	24	21	17	22	23	20	16
1350		kW	2.03	2.07	2.13	2.2	2.17	2.21	2.27	2.3	2.29	2.33	2.40	2.5	2.39	2.44	2.51	2.6	2.48	2.53	2.60	2.7	2.56	2.61	2.69	2.8	
		Amps	7.3	7.5	7.7	8.0	7.9	8.0	8.3	8.6	8.5	8.7	9.0	9.3	9.1	9.3	9.6	9.9	9.6	9.9	10.2	10.6	10.2	10.4	10.8	11.2	
1050		Hi PR	217	234	247	257	244	262	277	289	277	298	315	328	315	339	359	374	355	382	403	421	392	422	446	465	
		Lo PR	108	115	126	134	114	122	133	142	119	127	138	147	125	133	145	155	131	139	152	162	135	144	157	168	
1180		MBh	35.7	36.5	39.0	41.7	34.9	35.6	38.1	40.7	34.0	34.8	37.2	39.7	33.2	33.9	36.3	38.8	31.5	32.2	34.4	36.8	29.2	29.9	31.9	34.1	
		S/T	1.00	0.92	0.75	0.6	1.00	0.95	0.77	0.6	1.00	1.00	0.79	0.6	1.00	1.00	0.82	0.6	1.00	1.00	0.85	0.6	1.00	1.00	0.86	0.6	
1350	ΔT	24	23	20	16	24	23	20	16	23	24	20	16	23	20	16	12	21	22	20	16	20	20	19	15		
	kW	2.05	2.08	2.14	2.2	2.18	2.22	2.29	2.4	2.30	2.35	2.42	2.5	2.41	2.46	2.53	2.6	2.50	2.55	2.62	2.7	2.58	2.63	2.71	2.8		
1050	Amps	7.4	7.5	7.8	8.0	7.9	8.1	8.4	8.7	8.6	8.8	9.1	9.4	9.2	9.4	9.7	10.0	9.7	10.0	10.3	10.7	10.3	10.5	10.9	11.3		
	Hi PR	219	236	249	260	246	265	280	292	280	301	318	332	319	343	362	378	358	386	407	425	396	426	450	469		
1180	Lo PR	109	116	127	135	116	123	134	143	120	128	140	149	126	134	147	156	132	141	154	164	137	146	159	169		
	MBh	35.3	35.9	37.7	40.2	34.4	35.1	36.8	39.2	33.6	34.3	35.9	38.3	32.8	33.4	35.0	37.4	31.2	31.8	33.3	35.5	29.6	30.2	31.6	33.7		
1350	S/T	0.98	0.94	0.85	0.7	1.00	0.98	0.88	0.7	1.00	1.00	0.90	0.7	1.00	1.00	0.93	0.8	1.00	1.00	0.97	0.8	1.00	1.00	0.98	0.8		
	ΔT	27	26	25	22	27	27	25	22	26	27	25	22	26	26	25	22	24	25	25	22	22	23	23	20		
1050	kW	2.05	2.08	2.14	2.2	2.18	2.22	2.29	2.4	2.30	2.35	2.42	2.5	2.41	2.46	2.53	2.6	2.50	2.55	2.62	2.7	2.58	2.63	2.71	2.8		
	Amps	7.4	7.5	7.8	8.0	7.9	8.1	8.4	8.7	8.6	8.8	9.1	9.4	9.2	9.4	9.7	10.0	9.7	10.0	10.3	10.7	10.3	10.5	10.9	11.3		
1180	Hi PR	219	236	249	260	246	265	280	292	280	301	318	332	319	343	362	378	358	386	407	425	396	426	450	469		
	Lo PR	109	116	127	135	116	123	134	143	120	128	140	149	126	134	147	156	132	141	154	164	137	146	159	169		
1350	MBh	36.3	37.0	38.8	41.4	35.5	36.2	37.9	40.4	34.6	35.3	37.0	39.4	33.8	34.4	36.1	38.5	32.1	32.7	34.3	36.6	29.7	30.3	31.7	33.9		
	S/T	1.00	0.99	0.89	0.7	1.00	1.00	0.92	0.8	1.00	1.00	0.95	0.8	1.00	1.00	0.98	0.8	1.00	1.00	1.00	0.8	1.00	1.00	1.00	0.8		
1050	ΔT	25	25	24	20	24	25	24	21	24	24	24	21	23	23	24	21	22	22	23	20	20	21	22	19		
	kW	2.06	2.10	2.16	2.2	2.20	2.24	2.30	2.4	2.32	2.36	2.43	2.5	2.43	2.47	2.55	2.6	2.52	2.57	2.64	2.7	2.60	2.65	2.73	2.8		
1180	Amps	7.4	7.6	7.8	8.1	8.0	8.2	8.4	8.7	8.7	8.9	9.1	9.5	9.2	9.5	9.8	10.1	9.8	10.0	10.4	10.8	10.4	10.6	11.0	11.4		
	Hi PR	221	238	252	262	248	267	282	294	283	304	321	335	322	346	366	381	362	390	411	429	400	430	455	474		
1350	Lo PR	111	118	128	137	117	124	136	144	121	129	141	150	127	136	148	158	134	142	155	165	138	147	161	171		

kW = Total system power
Amps = outdoor unit amps

IDB*: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

AVZC200241A* / CA*F3642*6D* + MBVC1200**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	29.7	28.1	26.4	24.7	23.6	22.9	21.2	21.3	18.9	17.5	16.4	15.2	14.0	12.7	11.4	10.3	8.9	7.1
T/R	38.1	36.1	34.0	31.8	30.3	29.4	27.3	27.4	24.4	22.5	21.1	19.5	18.0	16.3	14.7	13.2	11.4	9.1
kW	2.03	1.96	1.97	1.92	1.87	1.86	1.79	2.01	1.91	1.86	1.85	1.82	1.74	1.65	1.60	1.56	1.51	1.39
Amps	8.5	8.1	8.2	8.0	7.7	7.7	7.4	8.4	7.9	7.7	7.7	7.5	7.2	6.8	6.6	6.4	6.2	5.7
COP	4.28	4.20	3.94	3.78	3.70	3.61	3.48	3.10	2.90	2.75	2.60	2.45	2.36	2.25	2.09	1.93	1.72	1.50
HI PR	486	467	452	439	427	421	410	323	312	304	296	292	288	281	274	268	262	256
LO PR	150	138	127	118	109	108	99	91	83	75	68	61	61	54	48	42	36	31

AVZC200361A* / CA*F3743*6D* + MBVC1600**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	44.0	41.7	39.2	36.6	35.0	33.9	31.5	29.1	35.9	33.1	30.5	28.8	27.7	24.9	22.1	19.2	16.4	13.4
T/R	35.0	33.2	31.2	29.2	27.9	27.0	25.1	23.1	28.6	26.4	24.3	22.9	22.1	19.8	17.6	15.3	13.1	10.7
kW	2.66	2.61	2.56	2.51	2.48	2.46	2.41	2.36	3.97	3.87	3.77	3.72	3.68	3.58	3.48	3.39	3.29	3.19
Amps	10.8	10.5	10.3	10.1	10.0	9.9	9.7	9.4	16.4	16.0	15.6	15.3	15.2	14.7	14.3	13.9	13.5	13.1
COP	4.84	4.67	4.49	4.28	4.14	4.04	3.83	3.61	2.65	2.51	2.37	2.27	2.21	2.04	1.86	1.67	1.46	1.24
HI PR	389	373	358	343	335	328	316	303	290	277	266	260	255	245	236	226	218	210
LO PR	146	136	127	117	110	106	98	87	78	70	62	57	55	47	40	34	30	23

AVZC200481A* / CA*F4961*6D* + MBVC2000**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	57.2	54.1	51.0	47.6	45.5	44.1	41.0	45.5	42.4	39.1	36.0	34.0	32.7	29.4	26.0	22.7	19.4	15.9
T/R	36.8	34.8	32.8	30.6	29.3	28.3	26.3	29.3	27.2	25.1	23.2	21.9	21.1	18.9	16.7	14.6	12.5	10.2
kW	3.71	3.63	3.55	3.47	3.42	3.38	3.31	3.22	4.46	4.34	4.22	4.15	4.11	3.99	3.87	3.75	3.63	3.52
Amps	15.0	14.6	14.3	13.9	13.7	13.6	13.2	12.9	18.2	17.7	17.2	16.9	16.7	16.2	15.7	15.2	14.6	14.1
COP	4.52	4.37	4.21	4.03	3.90	3.82	3.63	4.14	2.79	2.64	2.50	2.40	2.34	2.16	1.97	1.77	1.56	1.32
HI PR	388	372	357	342	334	327	315	302	289	276	265	259	254	245	235	226	218	210
LO PR	143	133	125	114	108	104	96	85	77	69	60	56	54	46	39	33	29	23

AVZC200601A* / CA*F4961*6D* + MBVC2000**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	62.9	59.5	56.0	52.4	50.0	48.5	45.0	45.5	42.4	39.1	36.0	34.0	32.7	29.4	26.0	22.7	19.4	15.9
T/R	35.1	33.2	31.2	29.2	27.9	27.0	25.1	25.4	23.6	21.8	20.1	19.0	18.3	16.4	14.5	12.7	10.8	8.9
kW	4.01	3.94	3.87	3.80	3.76	3.73	3.66	3.59	4.31	4.21	4.12	4.07	4.03	3.94	3.85	3.76	3.66	3.57
Amps	15.6	15.3	15.0	14.7	14.6	14.4	14.1	13.8	16.9	16.5	16.1	15.9	15.7	15.3	14.9	14.6	14.1	13.8
COP	4.59	4.43	4.24	4.04	3.90	3.81	3.60	3.71	2.88	2.72	2.56	2.45	2.38	2.19	1.98	1.77	1.55	1.30
HI PR	381	365	351	336	328	322	309	297	284	272	261	255	250	240	231	222	214	206
LO PR	141	130	122	112	106	102	94	84	75	67	59	55	53	45	39	33	29	22

High pressure is measured at the suction service valve (the larger valve).

Low pressure is measured at the gauge port connection.

Amps = Outdoor unit amps (comp. +fan)

Calculations are based on 70 °F indoor dry bulb.

kW = Total system power

Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature.

AVZC200241A* / CA*F3642*6D* + MBVC1200**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	17.2	16.2	15.3	14.3	13.7	13.2	12.3	11.3	10.9	10.1	9.3	8.8	8.4	7.6	6.7	5.9	5.0	4.1
T/R	30.6	28.9	27.2	25.5	24.3	23.6	21.9	19.8	19.1	17.6	16.2	15.3	14.8	13.2	11.7	10.2	8.7	7.2
kW	1.21	1.19	1.16	1.14	1.13	1.12	1.10	1.07	1.03	1.01	0.99	0.97	0.97	0.94	0.92	0.90	0.87	0.85
Amps	5.1	5.0	4.9	4.8	4.7	4.7	4.6	4.5	4.3	4.2	4.1	4.0	4.0	3.9	3.8	3.7	3.6	3.5
COP	4.16	4.01	3.85	3.67	3.55	3.47	3.29	3.10	3.10	2.93	2.76	2.64	2.57	2.36	2.14	1.91	1.68	1.41
HI PR	451	432	416	397	388	381	366	351	336	321	309	301	296	284	274	262	253	244
LO PR	161	149	140	128	121	116	107	95	86	77	68	63	61	51	44	37	33	26

AVZC200361A* / CA*F3743*6D* + MBVC1600**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	31.7	30.0	28.3	26.4	25.2	24.5	22.7	21.0	22.9	21.1	19.5	18.4	17.7	15.9	14.1	12.3	10.5	8.6
T/R	35.8	33.9	31.9	29.9	28.5	27.6	25.7	22.1	24.1	22.2	20.5	19.3	18.6	16.7	14.8	12.9	11.0	9.0
kW	1.53	1.50	1.47	1.45	1.43	1.42	1.40	1.37	2.01	1.97	1.92	1.90	1.88	1.84	1.79	1.75	1.70	1.66
Amps	6.3	6.2	6.1	6.0	5.9	5.9	5.8	5.6	8.3	8.1	8.0	7.8	7.8	7.6	7.4	7.2	7.0	6.8
COP	6.10	5.87	5.62	5.35	5.16	5.04	4.77	4.48	3.34	3.15	2.97	2.84	2.76	2.54	2.30	2.06	1.80	1.52
HI PR	377	361	347	332	324	318	306	293	281	268	258	252	247	238	229	219	211	204
LO PR	144	133	125	115	108	104	96	85	77	69	60	56	54	46	40	33	29	23

AVZC200481A* / CA*F4961*6D* + MBVC2000**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	41.3	39.1	36.8	34.4	32.8	31.8	29.5	27.2	27.0	25.0	23.0	21.7	20.9	18.8	16.6	14.5	12.4	10.1
T/R	43.4	41.1	38.7	36.2	34.5	33.5	31.1	25.9	25.7	23.7	21.8	20.6	19.9	17.8	15.8	13.8	11.8	9.6
kW	2.14	2.10	2.05	2.00	1.98	1.96	1.91	1.86	2.27	2.21	2.16	2.12	2.10	2.04	1.98	1.92	1.86	1.80
Amps	8.8	8.6	8.4	8.2	8.1	8.0	7.8	7.5	9.3	9.0	8.8	8.6	8.5	8.3	8.0	7.8	7.5	7.2
COP	5.64	5.46	5.26	5.03	4.87	4.77	4.53	4.28	3.49	3.30	3.13	3.00	2.92	2.70	2.46	2.21	1.95	1.65
HI PR	376	360	346	331	323	317	305	293	280	268	257	251	246	237	228	219	211	203
LO PR	141	131	123	112	106	102	94	84	76	67	59	55	53	45	39	33	29	22

AVZC200601A* / CA*F4961*6D* + MBVC2000**-1A*+TXV

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	45.3	42.9	40.4	37.8	36.1	35.0	32.5	29.9	27.0	25.0	23.0	21.7	20.9	18.8	16.6	14.5	12.4	10.1
T/R	36.6	34.7	32.6	30.5	29.1	28.2	26.2	23.3	21.0	19.4	17.9	16.9	16.3	14.6	12.9	11.3	9.6	7.9
kW	2.29	2.26	2.22	2.19	2.17	2.16	2.13	2.09	2.17	2.13	2.10	2.08	2.06	2.03	1.99	1.96	1.92	1.88
Amps	9.3	9.2	9.0	8.9	8.8	8.8	8.6	8.4	8.7	8.6	8.4	8.3	8.2	8.1	7.9	7.8	7.6	7.5
COP	5.81	5.58	5.33	5.05	4.87	4.75	4.48	4.19	3.65	3.43	3.21	3.06	2.97	2.71	2.45	2.17	1.89	1.58
HI PR	369	354	340	325	318	312	300	288	276	263	253	247	242	233	224	215	207	200
LO PR	141	131	123	112	106	102	94	84	76	67	59	55	53	45	39	33	29	22

High pressure is measured at the suction service valve (the larger valve).

Low pressure is measured at the gauge port connection.

Amps = Outdoor unit amps (comp.+fan)

kW = Total system power

Calculations are based on 70 °F indoor dry bulb.

AVZC200241A* / CA*F3642*6D* + MBVC1200**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 100% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	25,900	18,500	7,400	1,400
80°	25,400	18,300	7,200	1,500
85°	25,000	18,000	6,900	1,600
90°	24,500	17,800	6,700	1,700
95°	24,000	17,600	6,400	1,800
100°	23,500	17,300	6,100	1,800
105°	22,900	17,100	5,800	1,900
110°	22,400	16,800	5,600	2,000
115°	21,700	16,500	5,200	2,100
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	22,400	17,000	5,400	1,700

AVZC200241A* / CA*F3642*6D* + MBVC1200**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 70% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	16,200	11,700	4,500	1,000
80°	16,000	11,600	4,400	1,000
85°	15,800	11,500	4,300	1,100
90°	15,600	11,600	4,000	1,100
95°	15,400	11,700	3,700	1,100
100°	15,000	11,600	3,400	1,100
105°	14,600	11,500	3,100	1,200
110°	14,100	11,100	3,000	1,200
115°	13,600	10,700	2,900	1,200
TVA CONDITIONS @ 95° OD DB, 75° ID, 63° ID WB				
95°	14,300	11,600	2,700	1,000

AVZC200361A* / CA*F3743*6D* + MBVC1600**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 100% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	39,300	28,400	10,900	2,000
80°	38,700	28,100	10,600	2,200
85°	38,000	27,800	10,200	2,300
90°	37,200	27,500	9,800	2,400
95°	36,400	27,100	9,400	2,600
100°	35,500	26,600	8,800	2,700
105°	34,400	26,100	8,300	2,800
110°	33,300	25,600	7,700	3,000
115°	32,100	25,100	7,100	3,100
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	34,000	26,200	7,900	2,500

AVZC200361A* / CA*F3743*6D* + MBVC1600**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 70% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	26,500	19,600	6,900	1,500
80°	26,200	19,600	6,500	1,600
85°	25,800	19,600	6,200	1,600
90°	25,500	19,600	5,900	1,600
95°	25,100	19,600	5,500	1,700
100°	24,500	19,500	5,000	1,700
105°	23,900	19,400	4,500	1,800
110°	23,100	18,800	4,300	1,800
115°	22,200	18,200	4,000	1,800
TVA CONDITIONS @ 95° OD DB, 75° ID, 63° ID WB				
95°	23,400	19,900	3,500	1,600

AVZC200481A* / CA*F4961*6D* + MBVC2000**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 100% DEMAND				
Outdoor Temp °F	Total BTU/h	Sensible BTU/h	Latent BTU/h	Total Watts
75°	52,500	37,900	14,600	2,900
80°	51,300	37,300	13,900	3,100
85°	50,000	36,800	13,300	3,200
90°	48,700	36,100	12,600	3,400
95°	47,300	35,500	11,800	3,600
100°	45,900	34,800	11,100	3,800
105°	44,400	34,100	10,300	3,900
110°	42,900	33,400	9,500	4,100
115°	41,400	32,700	8,700	4,300
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	44,300	34,300	10,000	3,500

AVZC200481A* / CA*F4961*6D* + MBVC2000**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 70% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	33,700	24,300	9,400	2,100
80°	33,300	24,300	9,000	2,100
85°	32,900	24,300	8,600	2,200
90°	32,500	24,400	8,100	2,300
95°	32,100	24,400	7,700	2,300
100°	31,300	24,200	7,100	2,400
105°	30,500	24,100	6,400	2,400
110°	29,400	23,300	6,000	2,400
115°	28,200	22,600	5,600	2,500
TVA CONDITIONS @ 95° OD DB, 75° ID, 63° ID WB				
95°	29,700	24,400	5,300	2,200

AVZC200601A* / CA*F4961*6D* + MBVC2000**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 100% DEMAND				
Outdoor Temp °F	Total BTU/h	Sensible BTU/h	Latent BTU/h	Total Watts
75°	58,800	42,000	16,700	3,300
80°	57,500	41,300	16,100	3,500
85°	56,100	40,600	15,500	3,700
90°	54,700	39,900	14,800	3,900
95°	53,300	39,200	14,100	4,100
100°	51,800	38,400	13,400	4,400
105°	50,200	37,600	12,500	4,600
110°	44,500	34,700	9,800	4,400
115°	34,100	29,000	5,100	2,800
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	49,700	37,700	12,000	4,100

AVZC200601A* / CA*F4961*6D* + MBVC2000**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F AT 70% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	37,000	27,400	9,600	2,270
80°	36,600	27,400	9,100	2,400
85°	36,100	27,400	8,700	2,400
90°	35,700	27,400	8,200	2,500
95°	35,200	27,500	7,700	2,500
100°	34,300	27,300	7,000	2,600
105°	33,400	27,100	6,300	2,600
110°	32,200	26,200	6,000	2,600
115°	31,000	25,400	5,600	2,700
TVA CONDITIONS @ 95° OD DB, 75° ID, 63° ID WB				
95°	32,600	27,100	5,500	2,400

AVZC200241A* / CA*F3642*6D* + MBVC1200**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	27,200	19,700	7,400	1,800
80°	26,700	19,500	7,100	1,900
85°	26,100	19,300	6,900	1,900
90°	25,600	19,000	6,600	2,000
95°	25,000	18,700	6,300	2,100
100°	24,400	18,500	6,000	2,200
105°	23,900	18,200	5,700	2,300
110°	21,500	17,200	4,300	2,300
115°	21,700	16,500	5,200	2,100
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	23,400	18,100	5,300	2,100

AVZC200361A* / CA*F3743*6D* + MBVC1600**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	40,100	29,400	10,700	2,100
80°	39,400	29,100	10,300	2,300
85°	38,700	28,800	9,900	2,400
90°	37,900	28,400	9,500	2,500
95°	37,000	28,000	9,000	2,700
100°	36,000	27,500	8,500	2,800
105°	34,800	27,000	7,900	3,000
110°	33,700	26,400	7,300	3,100
115°	32,100	25,100	7,100	3,100
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	34,600	27,000	7,600	2,700

AVZC200481A* / CA*F4961*6D* + MBVC2000**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	54,600	38,900	15,700	3,400
80°	53,300	38,300	15,000	3,600
85°	51,900	37,600	14,300	3,800
90°	50,500	37,000	13,500	4,000
95°	49,000	36,300	12,700	4,200
100°	47,600	35,600	11,900	4,400
105°	46,100	34,900	11,100	4,600
110°	44,500	34,200	10,300	4,800
115°	41,400	32,700	8,700	4,300
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	46,000	35,200	10,800	4,100

AVZC200601A* / CA*F4961*6D* + MBVC2000**-1A* + TXV DESIGN SUBCOOLING @ AHRI 95 °F CONDITIONS, 7-9 °F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	64,400	45,000	19,300	4,000
80°	62,800	44,200	18,600	4,200
85°	61,300	43,400	17,800	4,500
90°	59,600	42,600	17,000	4,700
95°	58,000	41,800	16,200	4,900
100°	56,300	40,900	15,400	5,200
105°	54,000	39,800	14,200	5,400
110°	44,500	34,700	9,800	4,400
115°	34,100	29,000	5,100	2,800
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	54,200	40,400	13,800	4,900

COOLING MODE

TONNAGE	SPEED	TOTAL UNIT SOUND RATING (dBA)	OCTAVE BAND SPECTRUM FREQUENCY (Hz) ANALYSIS (dB)						
			125	250	500	1000	2000	4000	8000
2-ton	Minimum	58.4	37.1	49.9	52.6	54.4	49.4	42.6	34.7
	Intermediate	60.9	38.6	50.9	56.7	56.2	51.2	45.1	36.6
	Maximum	67.7	45.6	53.6	62.5	62.2	62.0	57.5	50.9
3-ton	Minimum	56	45.9	47.2	51.0	50.5	47.9	37.1	31.3
	Intermediate	63.5	43.7	49.5	56.9	59.4	58.1	51.8	45.6
	Maximum	74.2	57.5	61.4	68.2	69.4	68.4	63.4	52.3
4-ton	Minimum	56	45.9	47.2	51.0	50.5	47.9	37.1	31.3
	Intermediate	63.5	43.7	49.5	56.9	59.4	58.1	51.8	45.6
	Maximum	74.2	57.5	61.4	68.2	69.4	68.4	63.4	52.3
5-ton	Minimum	56.1	42.7	46.6	50.3	51.5	48.2	42.7	40.5
	Intermediate	61.1	38.2	45.2	55.3	56.5	55.7	48.1	43.1
	Maximum	73.9	53.0	59.3	68.8	69.1	68.2	61.2	52.4

HEATING MODE

TONNAGE	SPEED	TOTAL UNIT SOUND RATING (dBA)	OCTAVE BAND SPECTRUM FREQUENCY (Hz) ANALYSIS (dB)						
			125	250	500	1000	2000	4000	8000
2-ton	Minimum	65	44.6	55.8	60.1	60.0	57.8	49.9	43.4
	Intermediate	65.3	44.3	54.3	60.8	60.5	58.3	50.3	41.1
	Maximum	76.3	54.1	67.2	73.7	68.5	66.5	62.2	51.2
3-ton	Minimum	69.4	49.7	63.3	62.5	63.0	62.9	53.2	47.5
	Intermediate	73.8	60.1	68.5	67.6	66.8	65.2	58.7	50.9
	Maximum	78.4	62.0	69.2	72.2	74.0	71.5	66.9	55.9
4-ton	Minimum	69.4	49.7	63.3	62.5	63.0	62.9	53.2	47.5
	Intermediate	73.8	60.1	68.5	67.6	66.8	65.2	58.7	50.9
	Maximum	78.4	62.0	69.2	72.2	74.0	71.5	66.9	55.9
5-ton	Minimum	59.4	49.8	54.6	54.8	53.1	49.8	38.2	28.9
	Intermediate	73.5	58.9	65.2	69.8	66.6	65.0	56.8	48.2
	Maximum	78.5	60.3	67.3	74.8	73.0	70.9	66.6	54.7



AWARDED THE ENERGY STAR MOST EFFICIENT MARK IN 2017 [^]

OUTDOOR UNIT	INDOOR UNITS	COOLING RATINGS				TVA RATINGS ³		HEATING RATINGS			CFM	AHRI #
	COILS/AIR HANDLERS	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	H	HSPF ⁴	Low		
AVZC200241A*	CA*F3642*6D*+MBVC1200**-1A*+TXV	23,400	17,200	21.0	13.0	21,800	17,100	23,600	10.0	15,200	725	8669105
AVZC200361A*	CA*F3743*6D*+MBVC1600**-1A*+TXV	35,400	26,800	21.0	14.0	32,800	26,600	35,000	10.0	28,800	1,165	8669332
AVZC200481A*	CA*F4961*6D*+MBVC2000**-1A*+TXV	46,500	34,600	20.0	13.0	43,000	34,000	45,500	10.0	34,000	1,440	8669655
AVZC200601A*	CA*F4961*6D*+MBVC2000**-1A*+TXV	52,500	40,000	20.0	12.5	48,500	39,500	50,000	10.0	34,000	1,660	8674931

ENERGY STAR NOTES

- Products that are recognized as the Most Efficient of ENERGY STAR® in 2017 prevent greenhouse gas emissions by meeting rigorous energy efficiency performance levels set by the U.S. Environmental Protection Agency.
- Proper sizing and installation of equipment is critical to achieving optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.
- The www.energystar.gov website provides up-to-date system combinations certified to meet ENERGY STAR requirements.

¹ Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

² Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

³ TVA Rating: BTU/h @ 75°F/ 63°F - 95°F

⁴ HSPF = Heating Seasonal Performance Factor

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Amana® brand gas furnace contains the EEP cooling time delay

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
AVZC20 0241A*	AVPVC24C14A*		23,400	17,200	21.0	13.0	21,800	17,100	23,600	10.0	15,200	725	8669300
	CA*F3137*6A*+MBVC1200**-1A*+TXV		23,800	17,500	21.0	13.0	22,000	17,400	23,800	10.0	15,200	720	8657940
	CA*F3137*6A*+TXV	A*VC80604B*B*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8669087
	CA*F3137*6A*+TXV	A*VC960403BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669088
	CA*F3137*6A*+TXV	A*VC960603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8669089
	CA*F3137*6A*+TXV	A*VM970603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8669090
	CA*F3137*6A*+TXV	A*VC960803BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669091
	CA*F3137*6A*+TXV	A*VM970803BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669092
	CA*F3137*6A*+TXV	G*VC80604B*B*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8796570
	CA*F3137*6A*+TXV	G*VC960403BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796571
	CA*F3137*6A*+TXV	G*VC960603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8796572
	CA*F3137*6A*+TXV	G*VC960803BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796573
	CA*F3137*6A*+TXV	G*VM970603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8796574
	CA*F3137*6A*+TXV	G*VM970803BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796575
	CA*F3636*6D*+MBVC1200**-1A*+TXV		23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,200	720	8669093
	CA*F3636*6D*+TXV	A*VC80604B*B*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8669094
	CA*F3636*6D*+TXV	A*VC960403BNA*	22,800	16,800	20.0	12.5	21,200	16,700	23,000	9.6	15,000	720	8669095
	CA*F3636*6D*+TXV	A*VM970603BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,400	9.6	15,200	720	8669096
	CA*F3636*6D*+TXV	A*VC960603BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,400	9.6	15,200	720	8669097
	CA*F3636*6D*+TXV	A*VC960804CNA*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8669098
	CA*F3636*6D*+TXV	A*VC960803BNA*	22,800	16,800	19.5	12.5	21,200	16,700	23,000	9.6	15,000	720	8669099
	CA*F3636*6D*+TXV	A*VM970803BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,400	9.6	15,200	720	8669100
	CA*F3636*6D*+TXV	A*VM970804CNA*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8669101
	CA*F3636*6D*+TXV	G*VC80604B*B*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8796576
	CA*F3636*6D*+TXV	G*VC960403BNA*	22,800	16,800	20.0	12.5	21,200	16,700	23,000	9.6	15,000	720	8796577
	CA*F3636*6D*+TXV	G*VC960603BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,400	9.6	15,200	720	8796578
	CA*F3636*6D*+TXV	G*VC960803BNA*	22,800	16,800	19.5	12.5	21,200	16,700	23,000	9.6	15,000	720	8796579
	CA*F3636*6D*+TXV	G*VC960804CNA*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8796580
	CA*F3636*6D*+TXV	G*VM970603BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,400	9.6	15,200	720	8796581
	CA*F3636*6D*+TXV	G*VM970803BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,400	9.6	15,200	720	8796582
	CA*F3636*6D*+TXV	G*VM970804CNA*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8796583
	CA*F3642*6D*+TXV	A*VC80604B*B*	23,000	17,000	20.0	13.0	21,400	16,800	23,400	9.6	15,000	720	8669107
	CA*F3642*6D*+TXV	A*VC960603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8669108
	CA*F3642*6D*+TXV	A*VC960403BNA*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8669109
	CA*F3642*6D*+TXV	A*VC960803BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,200	9.6	15,000	720	8669111
	CA*F3642*6D*+TXV	A*VM970603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8669112
	CA*F3642*6D*+TXV	A*VM970804CNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669113
	CA*F3642*6D*+TXV	A*VM970803BNA*	23,200	17,100	19.5	12.5	21,600	17,000	23,400	9.6	15,200	720	8669265
	CA*F3642*6D*+TXV	A*VC960804CNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669273
	CA*F3642*6D*+TXV	G*VC80604B*B*	23,000	17,000	20.0	13.0	21,400	16,800	23,400	9.6	15,000	720	8796584
	CA*F3642*6D*+TXV	G*VC960403BNA*	23,000	17,000	20.0	12.5	21,400	16,800	23,200	9.6	15,000	720	8796585
	CA*F3642*6D*+TXV	G*VC960603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8796586
CA*F3642*6D*+TXV	G*VC960803BNA*	23,000	17,000	19.5	12.5	21,400	16,800	23,200	9.6	15,000	720	8796587	
CA*F3642*6D*+TXV	G*VC960804CNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796588	
CA*F3642*6D*+TXV	G*VM970603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8796589	
CA*F3642*6D*+TXV	G*VM970803BNA*	23,200	17,100	19.5	12.5	21,600	17,000	23,400	9.6	15,200	720	8796590	
CA*F3642*6D*+TXV	G*VM970804CNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796591	

See Notes on Page 34.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ^3		HEATING RATINGS ^			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
AVZC20 0241A* (cont.)	CA*F3743*6D*+MBVC1200**-1A*+TXV		23,800	17,500	21.0	13.0	22,000	17,400	23,800	10.0	15,200	720	8669274
	CA*F3743*6D*+TXV	A*VC960403BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669275
	CA*F3743*6D*+TXV	A*VC80604B*B*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8669276
	CA*F3743*6D*+TXV	A*VM970603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8669277
	CA*F3743*6D*+TXV	A*VC960603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8669278
	CA*F3743*6D*+TXV	A*VC960804CNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8669279
	CA*F3743*6D*+TXV	A*VM970803BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8669280
	CA*F3743*6D*+TXV	A*VC960803BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8669281
	CA*F3743*6D*+TXV	A*VM970804CNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8669282
	CA*F3743*6D*+TXV	G*VC80604B*B*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8796592
	CA*F3743*6D*+TXV	G*VC960403BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796593
	CA*F3743*6D*+TXV	G*VC960603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8796594
	CA*F3743*6D*+TXV	G*VC960803BNA*	23,200	17,100	20.0	13.0	21,600	17,000	23,400	10.0	15,000	720	8796595
	CA*F3743*6D*+TXV	G*VC960804CNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8796596
	CA*F3743*6D*+TXV	G*VM970603BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8796597
	CA*F3743*6D*+TXV	G*VM970803BNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8796598
	CA*F3743*6D*+TXV	G*VM970804CNA*	23,400	17,200	20.0	13.0	21,800	17,100	23,600	10.0	15,000	720	8796599
	CHPF3636B6C*+MBVC1200**-1A*+TXV		23,400	17,200	21.0	13.0	21,800	17,100	23,400	10.0	15,200	720	8669283
	CHPF3636B6C*+TXV	A*VC80604B*B*	23,600	17,400	20.0	12.5	21,800	17,300	23,600	9.6	15,000	720	8669284
	CHPF3636B6C*+TXV	A*VC960403BNA*	23,400	17,200	20.0	12.5	21,800	17,100	23,400	9.6	15,000	720	8669285
	CHPF3636B6C*+TXV	A*VC960603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8669286
	CHPF3636B6C*+TXV	A*VM970603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8669287
	CHPF3636B6C*+TXV	A*VM970804CNA*	23,600	17,400	20.0	12.5	21,800	17,300	23,600	9.6	15,000	720	8669288
	CHPF3636B6C*+TXV	A*VC960803BNA*	23,400	17,200	19.5	12.5	21,800	17,100	23,400	9.6	15,000	720	8669289
	CHPF3636B6C*+TXV	A*VM970803BNA*	23,200	17,100	19.5	12.5	21,600	17,000	23,400	9.6	15,200	720	8669290
	CHPF3636B6C*+TXV	A*VC960804CNA*	23,600	17,400	20.0	12.5	21,800	17,300	23,600	9.6	15,000	720	8669291
	CHPF3636B6C*+TXV	G*VC80604B*B*	23,600	17,400	20.0	12.5	21,800	17,300	23,600	9.6	15,000	720	8796600
	CHPF3636B6C*+TXV	G*VC960403BNA*	23,400	17,200	20.0	12.5	21,800	17,100	23,400	9.6	15,000	720	8796601
	CHPF3636B6C*+TXV	G*VC960603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8796602
	CHPF3636B6C*+TXV	G*VC960803BNA*	23,400	17,200	19.5	12.5	21,800	17,100	23,400	9.6	15,000	720	8796603
	CHPF3636B6C*+TXV	G*VC960804CNA*	23,600	17,400	20.0	12.5	21,800	17,300	23,600	9.6	15,000	720	8796604
	CHPF3636B6C*+TXV	G*VM970603BNA*	23,200	17,100	19.5	13.0	21,600	17,000	23,400	9.6	15,200	720	8796605
CHPF3636B6C*+TXV	G*VM970803BNA*	23,200	17,100	19.5	12.5	21,600	17,000	23,400	9.6	15,200	720	8796606	
CHPF3636B6C*+TXV	G*VM970804CNA*	23,600	17,400	20.0	12.5	21,800	17,300	23,600	9.6	15,000	720	8796607	
AVZC20 0361A*	AVPVC36D14A*		35,200	26,800	20.0	14.0	32,600	26,400	34,800	10.0	28,800	1,160	8669639
	AVPVC48D14A*		35,400	26,800	20.0	14.0	32,800	26,600	35,000	10.0	28,800	1,160	8669640
	CA*F3137*6A*+MBVC1200**-1A*+TXV		34,800	26,400	20.0	13.5	32,200	26,200	35,000	10.0	28,800	1,160	8669301
	CA*F3137*6A*+MBVC1600**-1A*+TXV		34,800	26,400	20.0	13.5	32,200	26,200	35,000	10.0	28,800	1,160	8669302
	CA*F3137*6A*+TXV	A*VC80604B*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8669303
	CA*F3137*6A*+TXV	A*VC960403BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8669304
	CA*F3137*6A*+TXV	A*VM970603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8669305
	CA*F3137*6A*+TXV	A*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669306
	CA*F3137*6A*+TXV	A*VC960603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8669307
	CA*F3137*6A*+TXV	A*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669308
	CA*F3137*6A*+TXV	G*VC80604B*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8796608
	CA*F3137*6A*+TXV	G*VC960403BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8796609
	CA*F3137*6A*+TXV	G*VC960603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8796610
	CA*F3137*6A*+TXV	G*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796611

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
AVZC20 0361A* (cont.)	CA*F3137*6A*+TXV	G*VM970603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8796612
	CA*F3137*6A*+TXV	G*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796613
	CA*F3642*6D*+MBVC1200**-1A*+TXV		34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8669309
	CA*F3642*6D*+MBVC1600**-1A*+TXV		34,600	26,200	20.0	13.5	32,000	26,000	34,800	10.0	28,600	1,160	8669310
	CA*F3642*6D*+TXV	A*VC960603BNA*	34,400	26,200	19.0	12.5	31,800	25,800	34,800	9.6	28,600	1,160	8669311
	CA*F3642*6D*+TXV	A*VC960803BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669312
	CA*F3642*6D*+TXV	A*VC960804CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8669313
	CA*F3642*6D*+TXV	A*VM970804CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8669314
	CA*F3642*6D*+TXV	A*VM971005CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669315
	CA*F3642*6D*+TXV	A*VM971205DNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669322
	CA*F3642*6D*+TXV	A*VC960403BNA*	34,400	26,200	19.0	12.5	31,800	25,800	34,800	9.6	28,600	1,160	8669323
	CA*F3642*6D*+TXV	A*VM970603BNA*	34,400	26,200	19.0	12.5	31,800	25,800	34,800	9.6	28,600	1,160	8669324
	CA*F3642*6D*+TXV	A*VM970803BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669325
	CA*F3642*6D*+TXV	A*VC80604B*B*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8669326
	CA*F3642*6D*+TXV	A*VC80805C*B*	34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8669327
	CA*F3642*6D*+TXV	A*VC81005C*B*	34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8669328
	CA*F3642*6D*+TXV	A*VC961005CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669329
	CA*F3642*6D*+TXV	A*VC961205DNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669330
	CA*F3642*6D*+TXV	G*VC80604B*B*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8796614
	CA*F3642*6D*+TXV	G*VC80805C*B*	34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8796615
	CA*F3642*6D*+TXV	G*VC81005C*B*	34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8796616
	CA*F3642*6D*+TXV	G*VC960403BNA*	34,400	26,200	19.0	12.5	31,800	25,800	34,800	9.6	28,600	1,160	8796617
	CA*F3642*6D*+TXV	G*VC960603BNA*	34,400	26,200	19.0	12.5	31,800	25,800	34,800	9.6	28,600	1,160	8796618
	CA*F3642*6D*+TXV	G*VC960803BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796619
	CA*F3642*6D*+TXV	G*VC960804CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8796620
	CA*F3642*6D*+TXV	G*VC961005CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796621
	CA*F3642*6D*+TXV	G*VC961205DNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796622
	CA*F3642*6D*+TXV	G*VM970603BNA*	34,400	26,200	19.0	12.5	31,800	25,800	34,800	9.6	28,600	1,160	8796623
	CA*F3642*6D*+TXV	G*VM970803BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796624
	CA*F3642*6D*+TXV	G*VM970804CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8796625
	CA*F3642*6D*+TXV	G*VM971005CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796626
	CA*F3642*6D*+TXV	G*VM971205DNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796627
	CA*F3743*6D*+MBVC1200**-1A*+TXV		35,200	26,800	20.0	13.5	32,600	26,400	35,000	10.0	28,800	1,160	8669331
	CA*F3743*6D*+TXV	A*VC80805C*B*	35,200	26,800	20.0	13.5	32,600	26,400	35,000	10.0	28,800	1,160	8669333
	CA*F3743*6D*+TXV	A*VC80604B*B*	34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8669334
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669573
	CA*F3743*6D*+TXV	A*VC81005C*B*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8669574
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,800	26,400	19.5	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669575
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669576
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669577
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669578
	CA*F3743*6D*+TXV	A*VM971005CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8669579
CA*F3743*6D*+TXV	A*VM971205DNA*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8669580	
CA*F3743*6D*+TXV	A*VC961205DNA*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8669581	
CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669582	
CA*F3743*6D*+TXV	A*VC960603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669583	
CA*F3743*6D*+TXV	A*VC961005CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8669584	
CA*F3743*6D*+TXV	G*VC80604B*B*	34,600	26,200	20.0	13.0	32,000	26,000	34,800	10.0	28,600	1,160	8796628	

See Notes on Page 34.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	HI ⁴	HSPF ⁵	LOW ⁶		
AVZC20 0361A* (cont.)	CA*F3743*6D*+TXV	G*VC80805C*B*	35,200	26,800	20.0	13.5	32,600	26,400	35,000	10.0	28,800	1,160	8796629
	CA*F3743*6D*+TXV	G*VC81005C*B*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8796630
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,800	26,400	19.5	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796631
	CA*F3743*6D*+TXV	G*VC960603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796632
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796633
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796634
	CA*F3743*6D*+TXV	G*VC961005CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8796635
	CA*F3743*6D*+TXV	G*VC961205DNA*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8796636
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796637
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796638
	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	26,200	20.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796639
	CA*F3743*6D*+TXV	G*VM971005CNA*	35,200	26,800	20.0	12.5	32,600	26,400	35,000	10.0	28,800	1,160	8796640
	CA*F3743*6D*+TXV	G*VM971205DNA*	35,200	26,800	20.0	13.0	32,600	26,400	35,000	10.0	28,800	1,160	8796641
	CHPF3642C6C*+MBVC1200**-1A*+TXV		34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8669585
	CHPF3642C6C*+MBVC1600**-1A*+TXV		35,000	26,600	20.0	13.5	32,400	26,200	34,800	10.0	28,600	1,160	8669586
	CHPF3642C6C*+TXV	A*VC960603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669587
	CHPF3642C6C*+TXV	A*VC960804CNA*	34,800	26,400	19.5	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8669588
	CHPF3642C6C*+TXV	A*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8669589
	CHPF3642C6C*+TXV	A*VM970804CNA*	34,800	26,400	19.5	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8669590
	CHPF3642C6C*+TXV	A*VM971205DNA*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	9.6	28,600	1,160	8669591
	CHPF3642C6C*+TXV	A*VM971005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8669592
	CHPF3642C6C*+TXV	A*VC960403BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669593
	CHPF3642C6C*+TXV	A*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8669594
	CHPF3642C6C*+TXV	A*VM970603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8669595
	CHPF3642C6C*+TXV	A*VC80604B*B*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8669596
	CHPF3642C6C*+TXV	A*VC81005C*B*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8669597
	CHPF3642C6C*+TXV	A*VC80805C*B*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8669598
	CHPF3642C6C*+TXV	A*VC961005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8669599
	CHPF3642C6C*+TXV	A*VC961205DNA*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	9.6	28,600	1,160	8669600
	CHPF3642C6C*+TXV	G*VC80604B*B*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8796642
	CHPF3642C6C*+TXV	G*VC80805C*B*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8796643
	CHPF3642C6C*+TXV	G*VC81005C*B*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	10.0	28,600	1,160	8796644
	CHPF3642C6C*+TXV	G*VC960403BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796645
	CHPF3642C6C*+TXV	G*VC960603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796646
	CHPF3642C6C*+TXV	G*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8796647
	CHPF3642C6C*+TXV	G*VC960804CNA*	34,800	26,400	19.5	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8796648
	CHPF3642C6C*+TXV	G*VC961005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8796649
	CHPF3642C6C*+TXV	G*VC961205DNA*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	9.6	28,600	1,160	8796650
	CHPF3642C6C*+TXV	G*VM970603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	34,800	9.6	28,600	1,160	8796651
	CHPF3642C6C*+TXV	G*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8796652
	CHPF3642C6C*+TXV	G*VM970804CNA*	34,800	26,400	19.5	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8796653
	CHPF3642C6C*+TXV	G*VM971005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	34,800	9.6	28,600	1,160	8796654
	CHPF3642C6C*+TXV	G*VM971205DNA*	34,800	26,400	20.0	13.0	32,200	26,200	34,800	9.6	28,600	1,160	8796655
	CHPF3743C6B*+MBVC1200**-1A*+TXV		35,000	26,600	20.0	13.5	32,400	26,200	35,000	10.0	28,800	1,160	8669601
	CHPF3743C6B*+MBVC1600**-1A*+TXV		35,200	26,800	20.0	13.5	32,600	26,400	35,000	10.0	28,800	1,160	8669602
	CHPF3743C6B*+TXV	A*VC80805C*B*	35,000	26,600	20.0	13.5	32,400	26,200	35,000	10.0	28,800	1,160	8669603
	CHPF3743C6B*+TXV	A*VC81005C*B*	35,000	26,600	20.0	13.0	32,400	26,200	35,000	10.0	28,800	1,160	8669604
	CHPF3743C6B*+TXV	A*VC80604B*B*	35,000	26,600	20.0	13.0	32,400	26,200	35,000	10.0	28,800	1,160	8669605
	CHPF3743C6B*+TXV	A*VM970603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669606
	CHPF3743C6B*+TXV	A*VM970803BNA*	35,000	26,600	19.0	12.5	32,400	26,200	35,000	9.6	28,800	1,160	8669607
CHPF3743C6B*+TXV	A*VC960403BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669608	
CHPF3743C6B*+TXV	A*VM971005CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8669609	

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	HI ⁴	HSPF ⁵	LOW ⁶		
AVZC20 0361A* (cont.)	CHPF3743C6B*+TXV	A*VM971205DNA*	35,000	26,600	19.5	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8669610
	CHPF3743C6B*+TXV	A*VM970804CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8669611
	CHPF3743C6B*+TXV	A*VC960803BNA*	35,000	26,600	19.0	12.5	32,400	26,200	35,000	9.6	28,800	1,160	8669612
	CHPF3743C6B*+TXV	A*VC960804CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8669613
	CHPF3743C6B*+TXV	A*VC960603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669614
	CHPF3743C6B*+TXV	A*VC961205DNA*	35,000	26,600	19.5	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8669615
	CHPF3743C6B*+TXV	A*VC961005CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8669616
	CHPF3743C6B*+TXV	G*VC80604B*B*	35,000	26,600	20.0	13.0	32,400	26,200	35,000	10.0	28,800	1,160	8796656
	CHPF3743C6B*+TXV	G*VC80805C*B*	35,000	26,600	20.0	13.5	32,400	26,200	35,000	10.0	28,800	1,160	8796657
	CHPF3743C6B*+TXV	G*VC81005C*B*	35,000	26,600	20.0	13.0	32,400	26,200	35,000	10.0	28,800	1,160	8796658
	CHPF3743C6B*+TXV	G*VC960403BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796659
	CHPF3743C6B*+TXV	G*VC960603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796660
	CHPF3743C6B*+TXV	G*VC960803BNA*	35,000	26,600	19.0	12.5	32,400	26,200	35,000	9.6	28,800	1,160	8796661
	CHPF3743C6B*+TXV	G*VC960804CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8796662
	CHPF3743C6B*+TXV	G*VC961005CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8796663
	CHPF3743C6B*+TXV	G*VC961205DNA*	35,000	26,600	19.5	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8796664
	CHPF3743C6B*+TXV	G*VM970603BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796665
	CHPF3743C6B*+TXV	G*VM970803BNA*	35,000	26,600	19.0	12.5	32,400	26,200	35,000	9.6	28,800	1,160	8796666
	CHPF3743C6B*+TXV	G*VM970804CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8796667
	CHPF3743C6B*+TXV	G*VM971005CNA*	35,000	26,600	20.0	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8796668
	CHPF3743C6B*+TXV	G*VM971205DNA*	35,000	26,600	19.5	12.5	32,400	26,200	35,000	10.0	28,800	1,160	8796669
	CSCF3642N6D*+MBVC1200**-1A*+TXV		34,800	26,400	20.0	13.5	32,200	26,200	35,000	10.0	28,800	1,160	8669617
	CSCF3642N6D*+MBVC1600**-1A*+TXV		35,000	26,600	20.0	13.5	32,400	26,200	35,000	10.0	28,800	1,160	8669618
	CSCF3642N6D*+TXV	A*VC960603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8669619
	CSCF3642N6D*+TXV	A*VC960804CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669621
	CSCF3642N6D*+TXV	A*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669622
	CSCF3642N6D*+TXV	A*VM970804CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669623
	CSCF3642N6D*+TXV	A*VM971205DNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669624
	CSCF3642N6D*+TXV	A*VM971005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669625
	CSCF3642N6D*+TXV	A*VC960403BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8669626
	CSCF3642N6D*+TXV	A*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669627
	CSCF3642N6D*+TXV	A*VM970603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8669628
	CSCF3642N6D*+TXV	A*VC80604B*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8669630
	CSCF3642N6D*+TXV	A*VC81005C*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8669631
	CSCF3642N6D*+TXV	A*VC80805C*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8669632
	CSCF3642N6D*+TXV	A*VC961005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669633
	CSCF3642N6D*+TXV	A*VC961205DNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8669634
	CSCF3642N6D*+TXV	G*VC80604B*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8796670
	CSCF3642N6D*+TXV	G*VC80805C*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8796671
	CSCF3642N6D*+TXV	G*VC81005C*B*	34,800	26,400	20.0	13.0	32,200	26,200	35,000	10.0	28,800	1,160	8796672
	CSCF3642N6D*+TXV	G*VC960403BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8796673
	CSCF3642N6D*+TXV	G*VC960603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8796674
	CSCF3642N6D*+TXV	G*VC960803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796675
	CSCF3642N6D*+TXV	G*VC960804CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796676
	CSCF3642N6D*+TXV	G*VC961005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796677
	CSCF3642N6D*+TXV	G*VC961205DNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796678
	CSCF3642N6D*+TXV	G*VM970603BNA*	34,600	26,200	19.0	12.5	32,000	26,000	35,000	9.6	28,800	1,160	8796679
	CSCF3642N6D*+TXV	G*VM970803BNA*	34,800	26,400	19.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796680
	CSCF3642N6D*+TXV	G*VM970804CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796681
	CSCF3642N6D*+TXV	G*VM971005CNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796682
CSCF3642N6D*+TXV	G*VM971205DNA*	34,800	26,400	20.0	12.5	32,200	26,200	35,000	9.6	28,800	1,160	8796683	

See Notes on Page 34.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ^3		HEATING RATINGS ^			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
AVZC20 0481A*	AVPVC48D14A*		45,500	33,800	20.0	12.5	42,000	33,400	45,500	10.0	33,400	1,440	8674930
	CA*F4860*6D*+MBVC1600**-1A*+TXV		44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8669641
	CA*F4860*6D*+MBVC2000**-1A*+TXV		45,000	33,400	20.0	12.5	41,500	33,000	45,000	10.0	33,400	1,440	8669642
	CA*F4860*6D*+TXV	A*VC80604B*B*	44,500	33,200	19.0	11.7	41,000	32,600	45,000	10.0	33,400	1,440	8669643
	CA*F4860*6D*+TXV	A*VC80805C*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8669646
	CA*F4860*6D*+TXV	A*VC81005C*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669647
	CA*F4860*6D*+TXV	A*VM970804CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669648
	CA*F4860*6D*+TXV	A*VM971005CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669649
	CA*F4860*6D*+TXV	A*VM971205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669650
	CA*F4860*6D*+TXV	A*VC960804CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669651
	CA*F4860*6D*+TXV	A*VC961205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669652
	CA*F4860*6D*+TXV	A*VC961005CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8669653
	CA*F4860*6D*+TXV	G*VC80604B*B*	44,500	33,200	19.0	11.7	41,000	32,600	45,000	10.0	33,400	1,440	8796684
	CA*F4860*6D*+TXV	G*VC80805C*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8796685
	CA*F4860*6D*+TXV	G*VC81005C*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796686
	CA*F4860*6D*+TXV	G*VC960804CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796687
	CA*F4860*6D*+TXV	G*VC961005CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796688
	CA*F4860*6D*+TXV	G*VC961205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796689
	CA*F4860*6D*+TXV	G*VM970804CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796690
	CA*F4860*6D*+TXV	G*VM971005CNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796691
	CA*F4860*6D*+TXV	G*VM971205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	33,400	1,440	8796692
	CA*F4961*6D*+MBVC1600**-1A*+TXV		46,500	34,600	20.0	12.5	43,000	34,000	45,500	10.0	34,000	1,440	8669654
	CA*F4961*6D*+TXV	A*VC81005C*B*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8669656
	CA*F4961*6D*+TXV	A*VM970804CNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8669657
	CA*F4961*6D*+TXV	A*VC80604B*B*	45,500	33,800	20.0	12.0	42,000	33,400	45,500	10.0	34,000	1,440	8669658
	CA*F4961*6D*+TXV	A*VC80805C*B*	46,000	34,200	20.0	12.5	42,500	33,600	45,500	10.0	34,000	1,440	8669659
	CA*F4961*6D*+TXV	A*VC961205DNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8669660
	CA*F4961*6D*+TXV	A*VC960804CNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8669661
	CA*F4961*6D*+TXV	A*VC961005CNA*	46,000	34,200	20.0	12.0	42,500	33,600	46,000	10.0	34,000	1,440	8669663
	CA*F4961*6D*+TXV	A*VM971005CNA*	46,000	34,200	20.0	12.0	42,500	33,600	46,000	10.0	34,000	1,440	8669673
	CA*F4961*6D*+TXV	A*VM971205DNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8669681
	CA*F4961*6D*+TXV	G*VC80604B*B*	45,500	33,800	20.0	12.0	42,000	33,400	45,500	10.0	34,000	1,440	8796693
	CA*F4961*6D*+TXV	G*VC80805C*B*	46,000	34,200	20.0	12.5	42,500	33,600	45,500	10.0	34,000	1,440	8796694
	CA*F4961*6D*+TXV	G*VC81005C*B*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8796695
	CA*F4961*6D*+TXV	G*VC960804CNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8796696
	CA*F4961*6D*+TXV	G*VC961005CNA*	46,000	34,200	20.0	12.0	42,500	33,600	46,000	10.0	34,000	1,440	8796697
	CA*F4961*6D*+TXV	G*VC961205DNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8796698
	CA*F4961*6D*+TXV	G*VM970804CNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8796699
	CA*F4961*6D*+TXV	G*VM971005CNA*	46,000	34,200	20.0	12.0	42,500	33,600	46,000	10.0	34,000	1,440	8796700
	CA*F4961*6D*+TXV	G*VM971205DNA*	46,000	34,200	20.0	12.5	42,500	33,600	46,000	10.0	34,000	1,440	8796701
	CHPF4860D6D*+MBVC1600**-1A*+TXV		45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	34,000	1,440	8669686
	CHPF4860D6D*+MBVC2000**-1A*+TXV		45,000	33,400	20.0	12.5	41,500	33,000	45,000	10.0	34,000	1,440	8669687
	CHPF4860D6D*+TXV	A*VC80604B*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8669688
	CHPF4860D6D*+TXV	A*VC80805C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8669702
	CHPF4860D6D*+TXV	A*VC81005C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8669711
	CHPF4860D6D*+TXV	A*VM971005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8669722
	CHPF4860D6D*+TXV	A*VM970804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8669732
	CHPF4860D6D*+TXV	A*VM971205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8669770
	CHPF4860D6D*+TXV	A*VC960804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8669794

See Notes on Page 34.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS ^				TVA RATINGS ^3		HEATING RATINGS ^			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	HI ⁴	HSPF ⁵	LOW ⁶		
AVZC20 0481A*	CHPF4860D6D*+TXV	A*VC961005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8669795
	CHPF4860D6D*+TXV	A*VC961205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8669839
	CHPF4860D6D*+TXV	G*VC80604B*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8796702
	CHPF4860D6D*+TXV	G*VC80805C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8796703
	CHPF4860D6D*+TXV	G*VC81005C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8796704
	CHPF4860D6D*+TXV	G*VC960804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8796705
	CHPF4860D6D*+TXV	G*VC961005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8796706
	CHPF4860D6D*+TXV	G*VC961205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8796707
	CHPF4860D6D*+TXV	G*VM970804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8796708
	CHPF4860D6D*+TXV	G*VM971005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,500	10.0	34,000	1,440	8796709
	CHPF4860D6D*+TXV	G*VM971205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,500	10.0	34,000	1,440	8796710
	CSCF4860N6D*+MBVC1600**-1A*+TXV		45,000	33,400	20.0	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8669931
	CSCF4860N6D*+MBVC2000**-1A*+TXV		45,000	33,400	20.0	12.5	41,500	33,000	45,000	10.0	33,400	1,440	8670115
	CSCF4860N6D*+TXV	A*VC80604B*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8670245
	CSCF4860N6D*+TXV	A*VC80805C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8670493
	CSCF4860N6D*+TXV	A*VM970804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8670644
	CSCF4860N6D*+TXV	A*VM971005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8671135
	CSCF4860N6D*+TXV	A*VC81005C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8671289
	CSCF4860N6D*+TXV	A*VC961205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8671388
	CSCF4860N6D*+TXV	A*VC961005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8671489
	CSCF4860N6D*+TXV	A*VC960804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8672435
	CSCF4860N6D*+TXV	A*VM971205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8672456
	CSCF4860N6D*+TXV	G*VC80604B*B*	44,500	33,200	19.0	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8796711
	CSCF4860N6D*+TXV	G*VC80805C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8796712
	CSCF4860N6D*+TXV	G*VC81005C*B*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8796713
	CSCF4860N6D*+TXV	G*VC960804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8796714
	CSCF4860N6D*+TXV	G*VC961005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8796715
	CSCF4860N6D*+TXV	G*VC961205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8796716
CSCF4860N6D*+TXV	G*VM970804CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8796717	
CSCF4860N6D*+TXV	G*VM971005CNA*	45,000	33,400	19.5	12.0	41,500	33,000	45,000	10.0	33,400	1,440	8796718	
CSCF4860N6D*+TXV	G*VM971205DNA*	44,500	33,200	19.5	12.0	41,000	32,600	45,000	10.0	33,400	1,440	8796719	
AVZC20 0601A*	AVPVC60D14A*		52,500	40,000	20.0	12.5	48,500	39,500	50,000	10.0	34,000	1,660	8676049
	CA*F4961*6D*+TXV	A*VC80805C*B*	52,500	40,000	18.5	12.2	48,500	39,500	50,000	10.0	34,000	1,660	8674935
	CA*F4961*6D*+TXV	A*VC81005C*B*	52,500	40,000	18.5	12.2	48,500	39,500	50,000	10.0	34,000	1,660	8674936
	CA*F4961*6D*+TXV	A*VC961005CNA*	52,500	40,000	18.0	12.0	48,500	39,500	50,000	10.0	34,000	1,660	8674937
	CA*F4961*6D*+TXV	A*VM971005CNA*	52,500	40,000	18.0	12.0	48,500	39,500	50,000	10.0	34,000	1,660	8674938
	CA*F4961*6D*+TXV	A*VC961205DNA*	52,500	40,000	18.5	12.5	48,500	39,500	50,000	10.0	34,000	1,660	8674939
	CA*F4961*6D*+TXV	A*VM971205DNA*	52,500	40,000	18.5	12.5	48,500	39,500	50,000	10.0	34,000	1,660	8674940
	CA*F4961*6D*+TXV	G*VC80805C*B*	52,500	40,000	18.5	12.2	48,500	39,500	50,000	10.0	34,000	1,660	8796720
	CA*F4961*6D*+TXV	G*VC81005C*B*	52,500	40,000	18.5	12.2	48,500	39,500	50,000	10.0	34,000	1,660	8796721
	CA*F4961*6D*+TXV	G*VC961005CNA*	52,500	40,000	18.0	12.0	48,500	39,500	50,000	10.0	34,000	1,660	8796722
	CA*F4961*6D*+TXV	G*VC961205DNA*	52,500	40,000	18.5	12.5	48,500	39,500	50,000	10.0	34,000	1,660	8796723
	CA*F4961*6D*+TXV	G*VM971005CNA*	52,500	40,000	18.0	12.0	48,500	39,500	50,000	10.0	34,000	1,660	8796724
	CA*F4961*6D*+TXV	G*VM971205DNA*	52,500	40,000	18.5	12.5	48,500	39,500	50,000	10.0	34,000	1,660	8796725
	CHPF4860D6D*+MBVC2000**-1A*+TXV		51,500	39,000	19.5	12.5	47,500	38,500	50,000	10.0	34,000	1,660	8674941
	CHPF4860D6D*+TXV	A*VM971205DNA*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8674942
	CHPF4860D6D*+TXV	A*VC961205DNA*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8674943
	CHPF4860D6D*+TXV	A*VM971005CNA*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8674944
CHPF4860D6D*+TXV	A*VC961005CNA*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8674945	

See Notes on Page 34.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	Hi ⁴	HSPF ⁵	Low ⁶		
AVZC20 0601A* (cont.)	CHPF4860D6D*+TXV	A*VC81005C*B*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8674946
	CHPF4860D6D*+TXV	A*VC80805C*B*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8675350
	CHPF4860D6D*+TXV	G*VC80805C*B*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8796726
	CHPF4860D6D*+TXV	G*VC81005C*B*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8796727
	CHPF4860D6D*+TXV	G*VC961005CNA*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8796728
	CHPF4860D6D*+TXV	G*VC961205DNA*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8796729
	CHPF4860D6D*+TXV	G*VM971005CNA*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8796730
	CHPF4860D6D*+TXV	G*VM971205DNA*	51,000	38,500	18.0	12.0	47,000	38,000	50,000	9.6	34,000	1,660	8796731
	CSCF4860N6D*+TXV	A*VC80805C*B*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8676043
	CSCF4860N6D*+TXV	A*VC81005C*B*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8676044
	CSCF4860N6D*+TXV	A*VC961005CNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8676045
	CSCF4860N6D*+TXV	A*VM971005CNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8676046
	CSCF4860N6D*+TXV	A*VC961205DNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8676047
	CSCF4860N6D*+TXV	A*VM971205DNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8676048
	CSCF4860N6D*+TXV	G*VC80805C*B*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8796732
	CSCF4860N6D*+TXV	G*VC81005C*B*	50,500	38,500	18.0	12.0	46,500	37,800	50,000	9.6	34,000	1,660	8796733
	CSCF4860N6D*+TXV	G*VC961005CNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8796734
	CSCF4860N6D*+TXV	G*VC961205DNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8796735
CSCF4860N6D*+TXV	G*VM971005CNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8796736	
CSCF4860N6D*+TXV	G*VM971205DNA*	50,000	38,000	18.0	12.0	46,500	37,400	50,000	9.6	34,000	1,660	8796737	

[^] Rated in accordance with ANSI/AHRI Standard 210/240

¹ Seasonal Energy Efficiency Ratio

³ TVA Rating: BTU/h @ 75°F/ 63°F - 95°F

⁵ HSPF = Heating Seasonal Performance Factor

⁷ CFM at High stage

² Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F


⁴ Rated heating capacity at 47°F outdoor per AHRI 210/240

⁶ Heating capacity at 17°F outdoor

⁸ CFM at Intermediate and low stage

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Amana brand gas furnace contains the EEP cooling time delay.

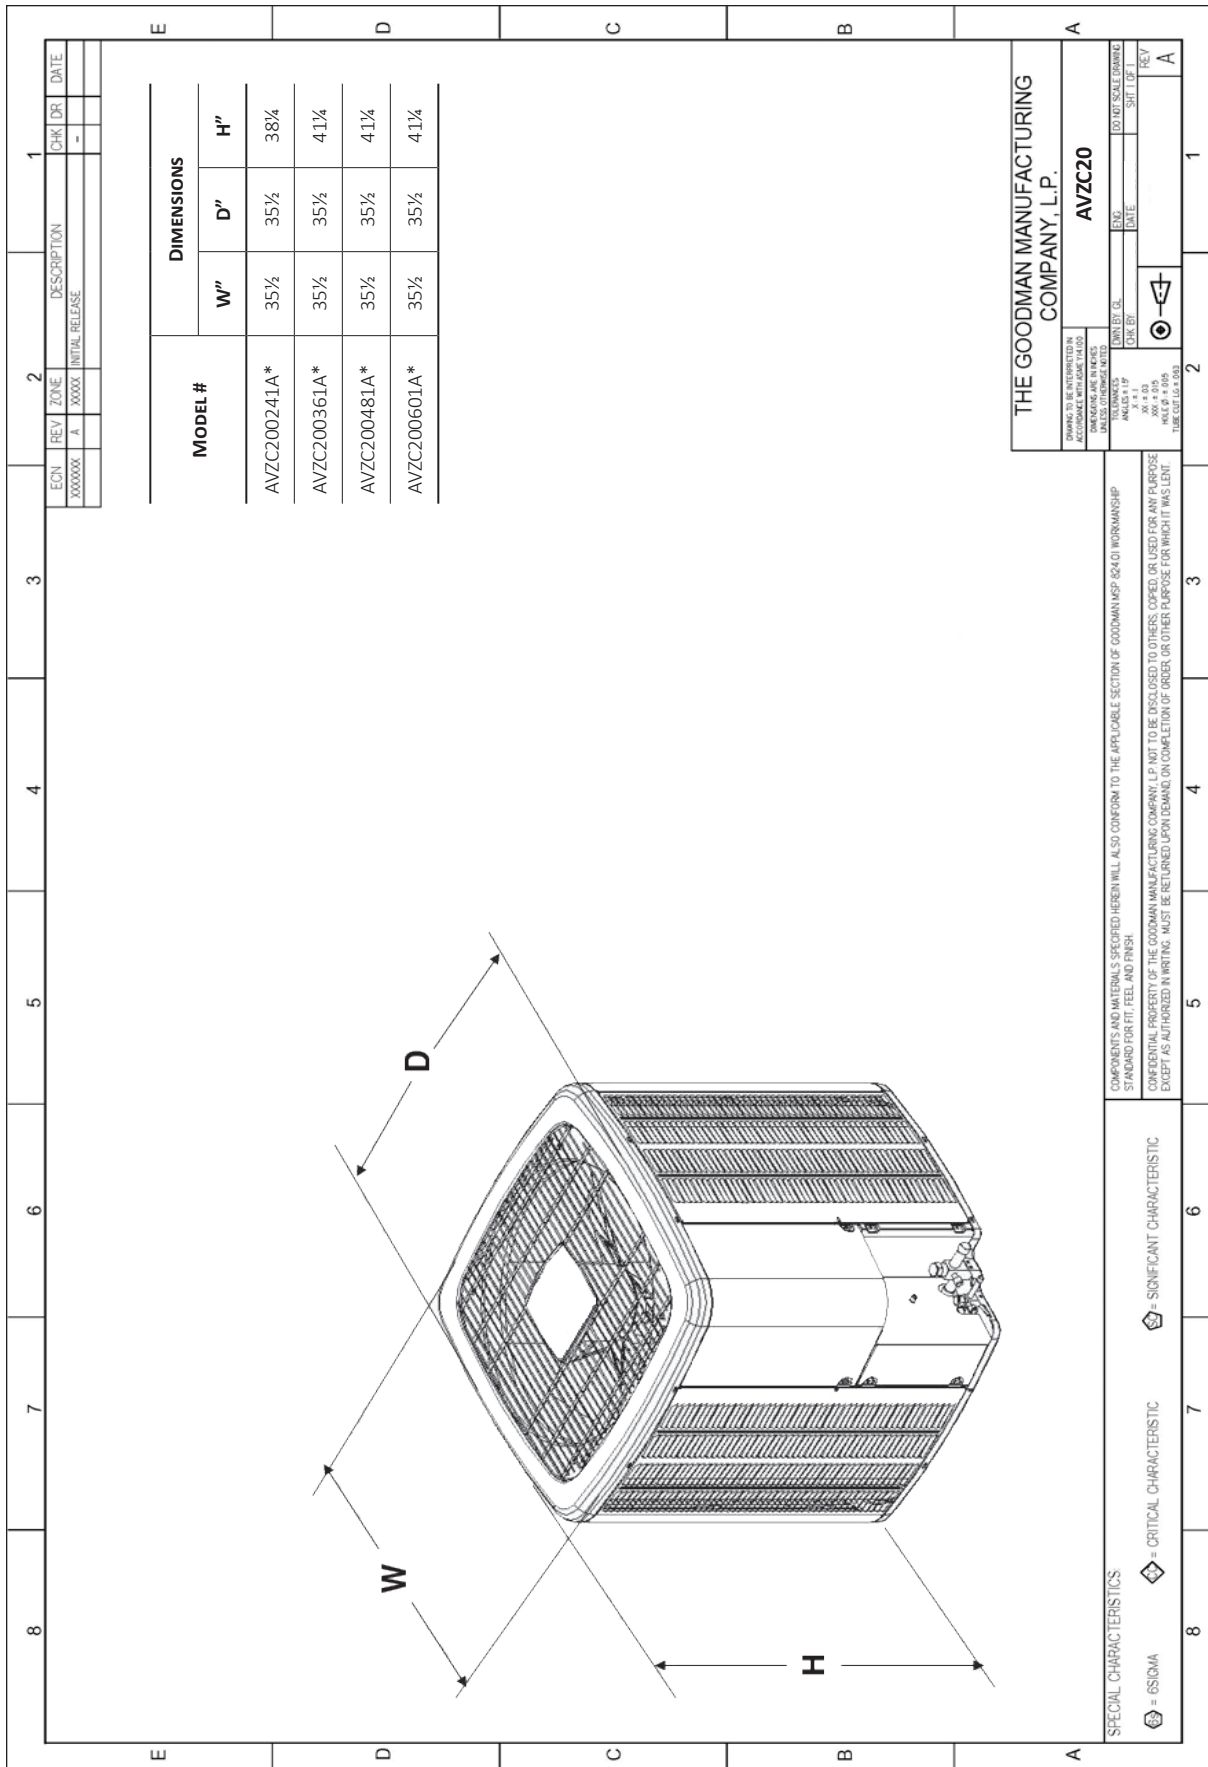

ECON	REV	ZONE	DESCRIPTION	CHK	DR	DATE
XXXXXXXX	A	XXXXX	INITIAL RELEASE	-	-	-

THE GOODMAN MANUFACTURING COMPANY, L.P.

AVZC20

ENGINEERING: [] DATE: []
 CHECKED BY: []
 TOLERANCES: X ± 0.1, Y ± 0.1, Z ± 0.1, HOLES ± 0.005, SURFACE ± 0.010

DO NOT SCALE DRAWING
 SHIT 1 OF 1

COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP 824 (I) WORKMANSHIP STANDARD FOR FIT, FEEL AND FINISH


CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY, L.P. NOT TO BE DISCLOSED TO OTHERS, COPIED, OR USED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.

SPECIAL CHARACTERISTICS

⊕ = 6SIGMA

⊕ = CRITICAL CHARACTERISTIC

⊕ = SIGNIFICANT CHARACTERISTIC

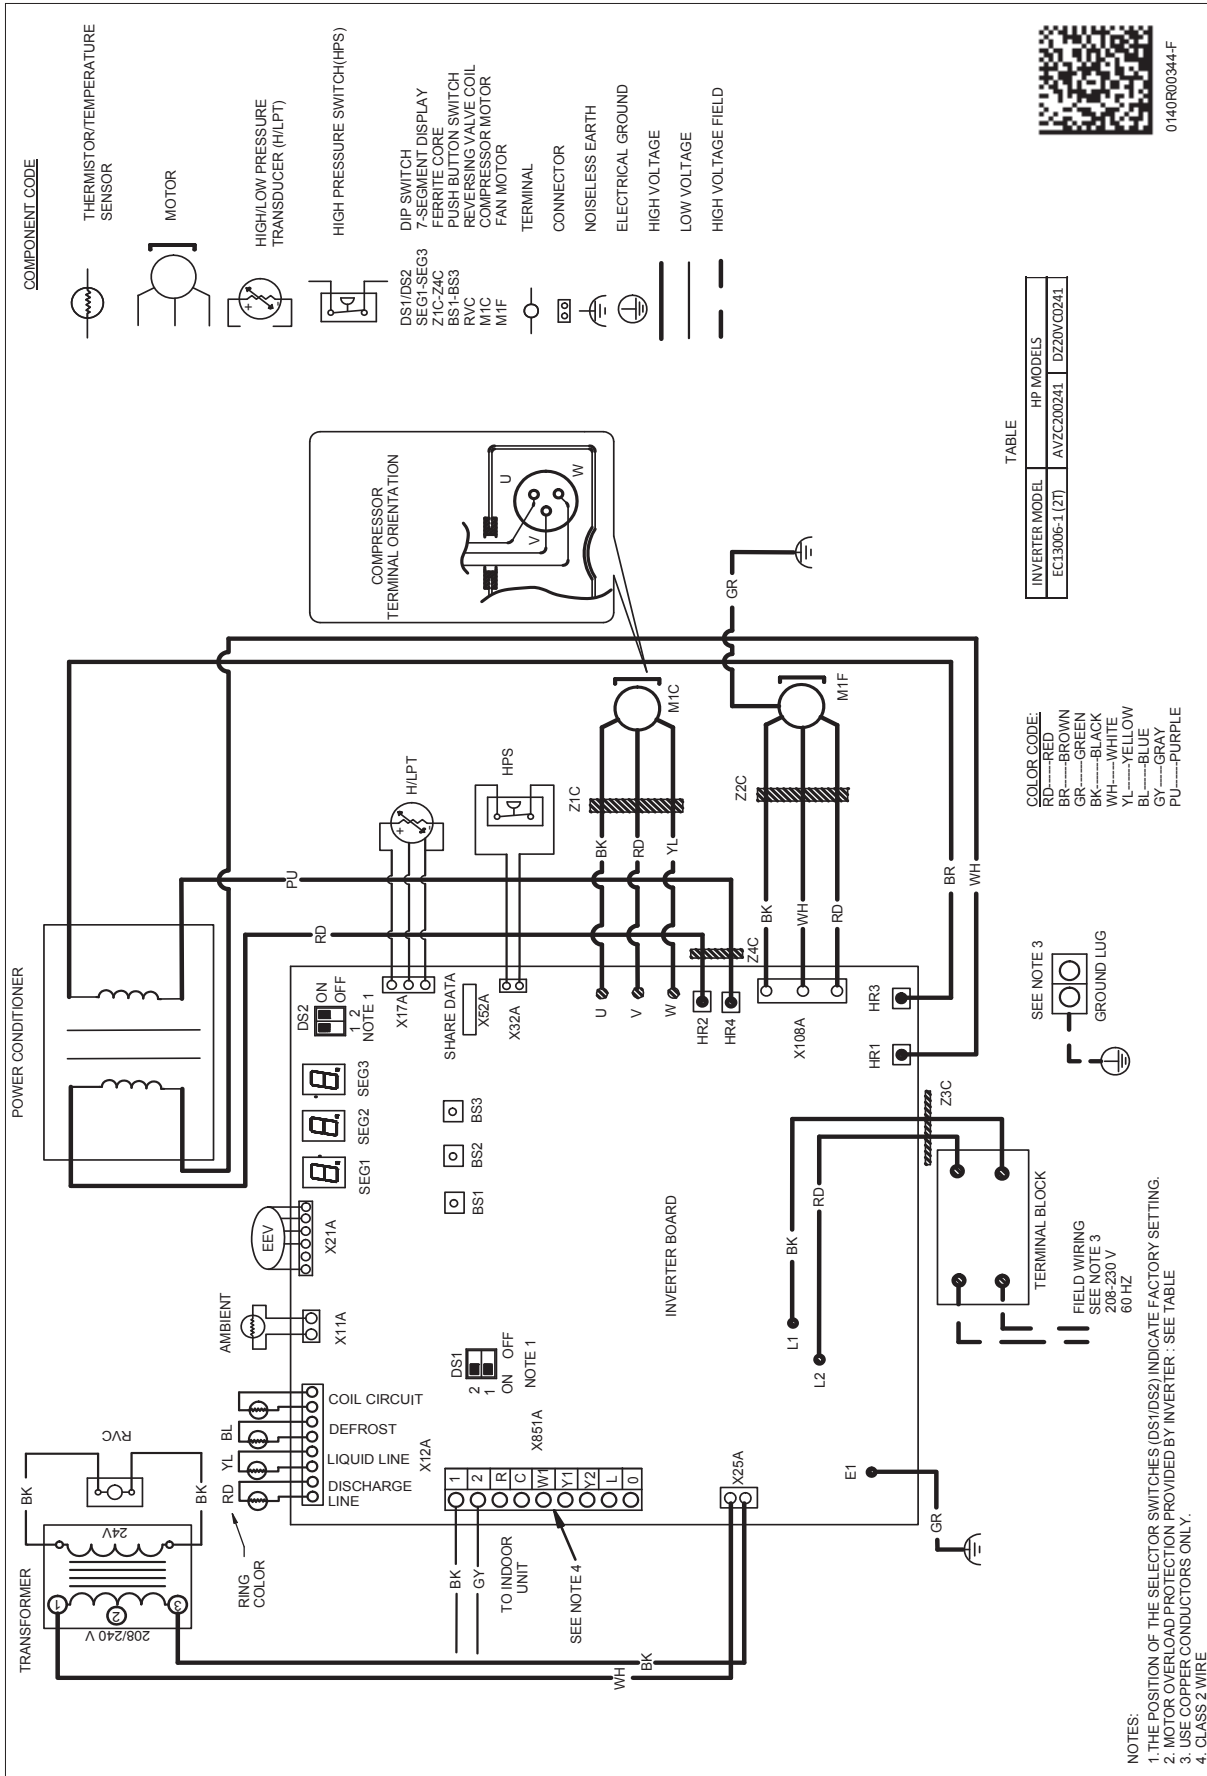


0140R00344 F

WARNING


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

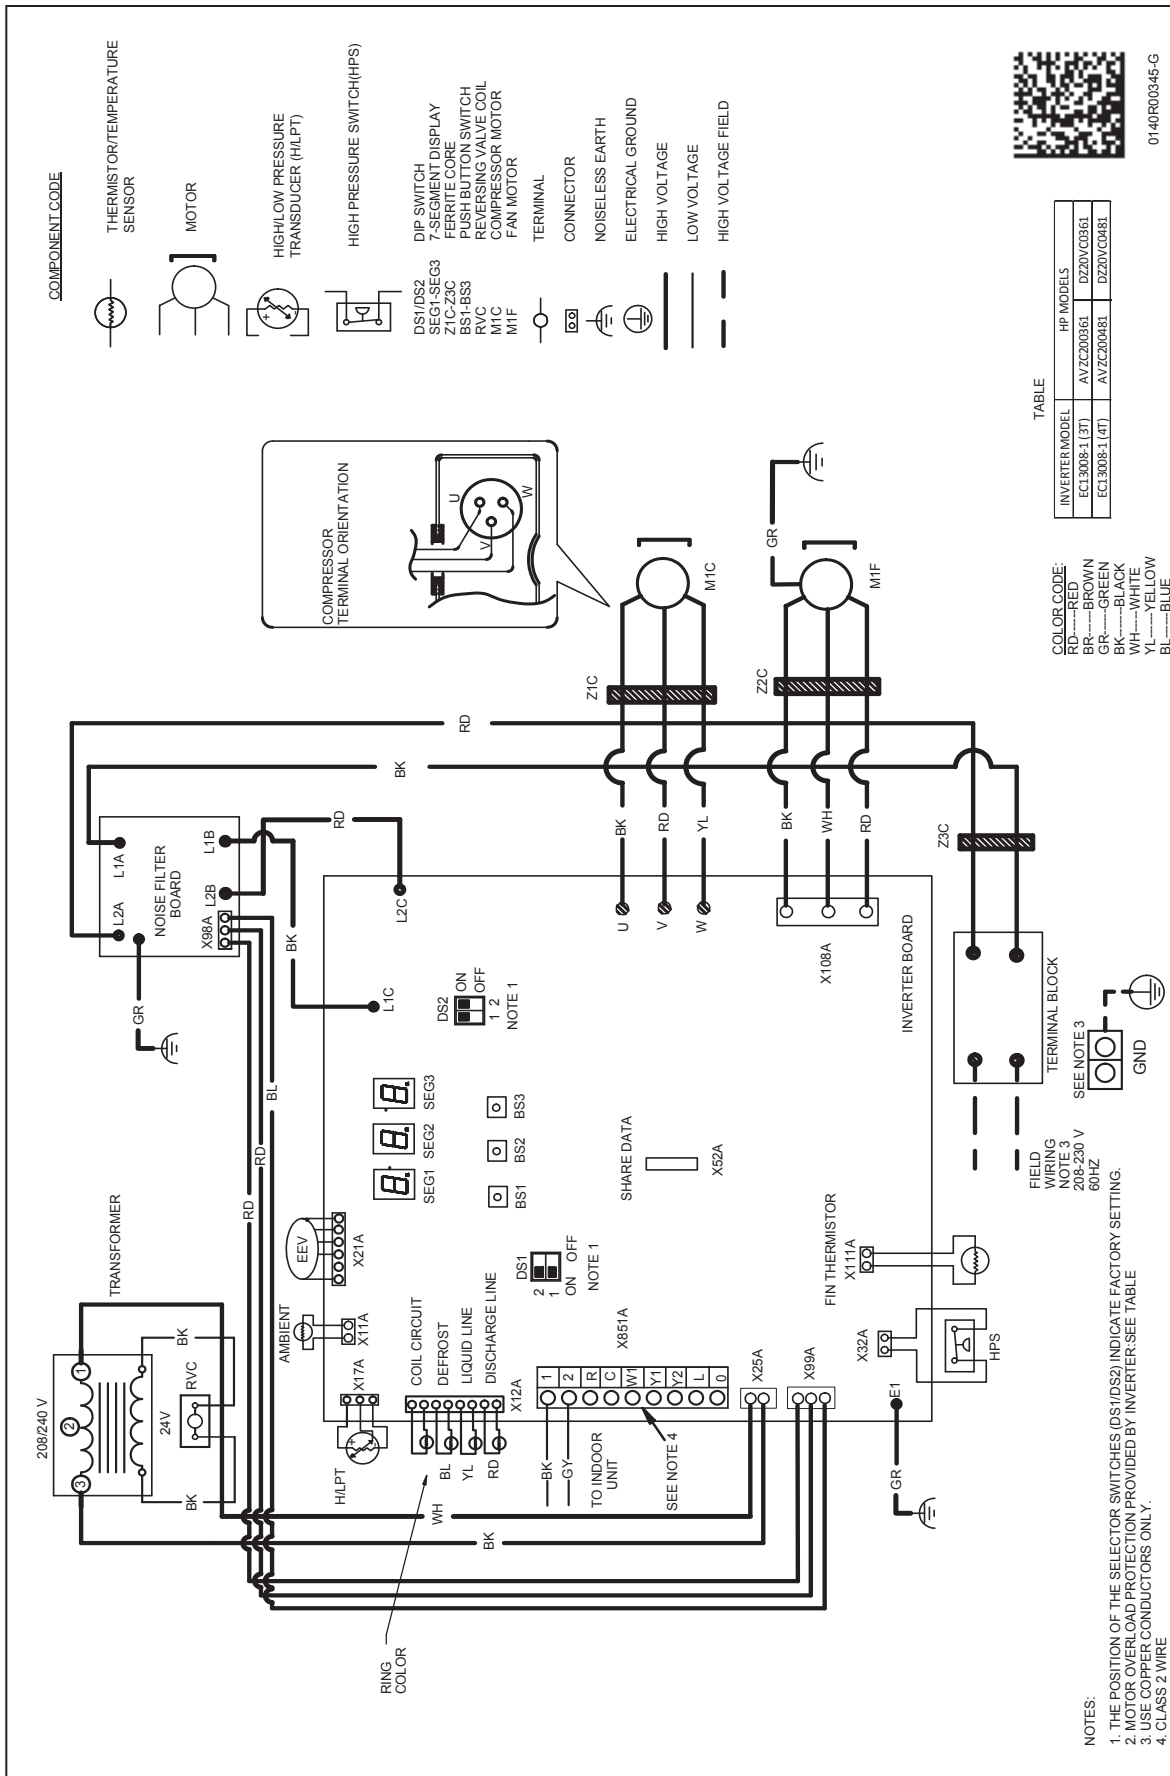

WARNING High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

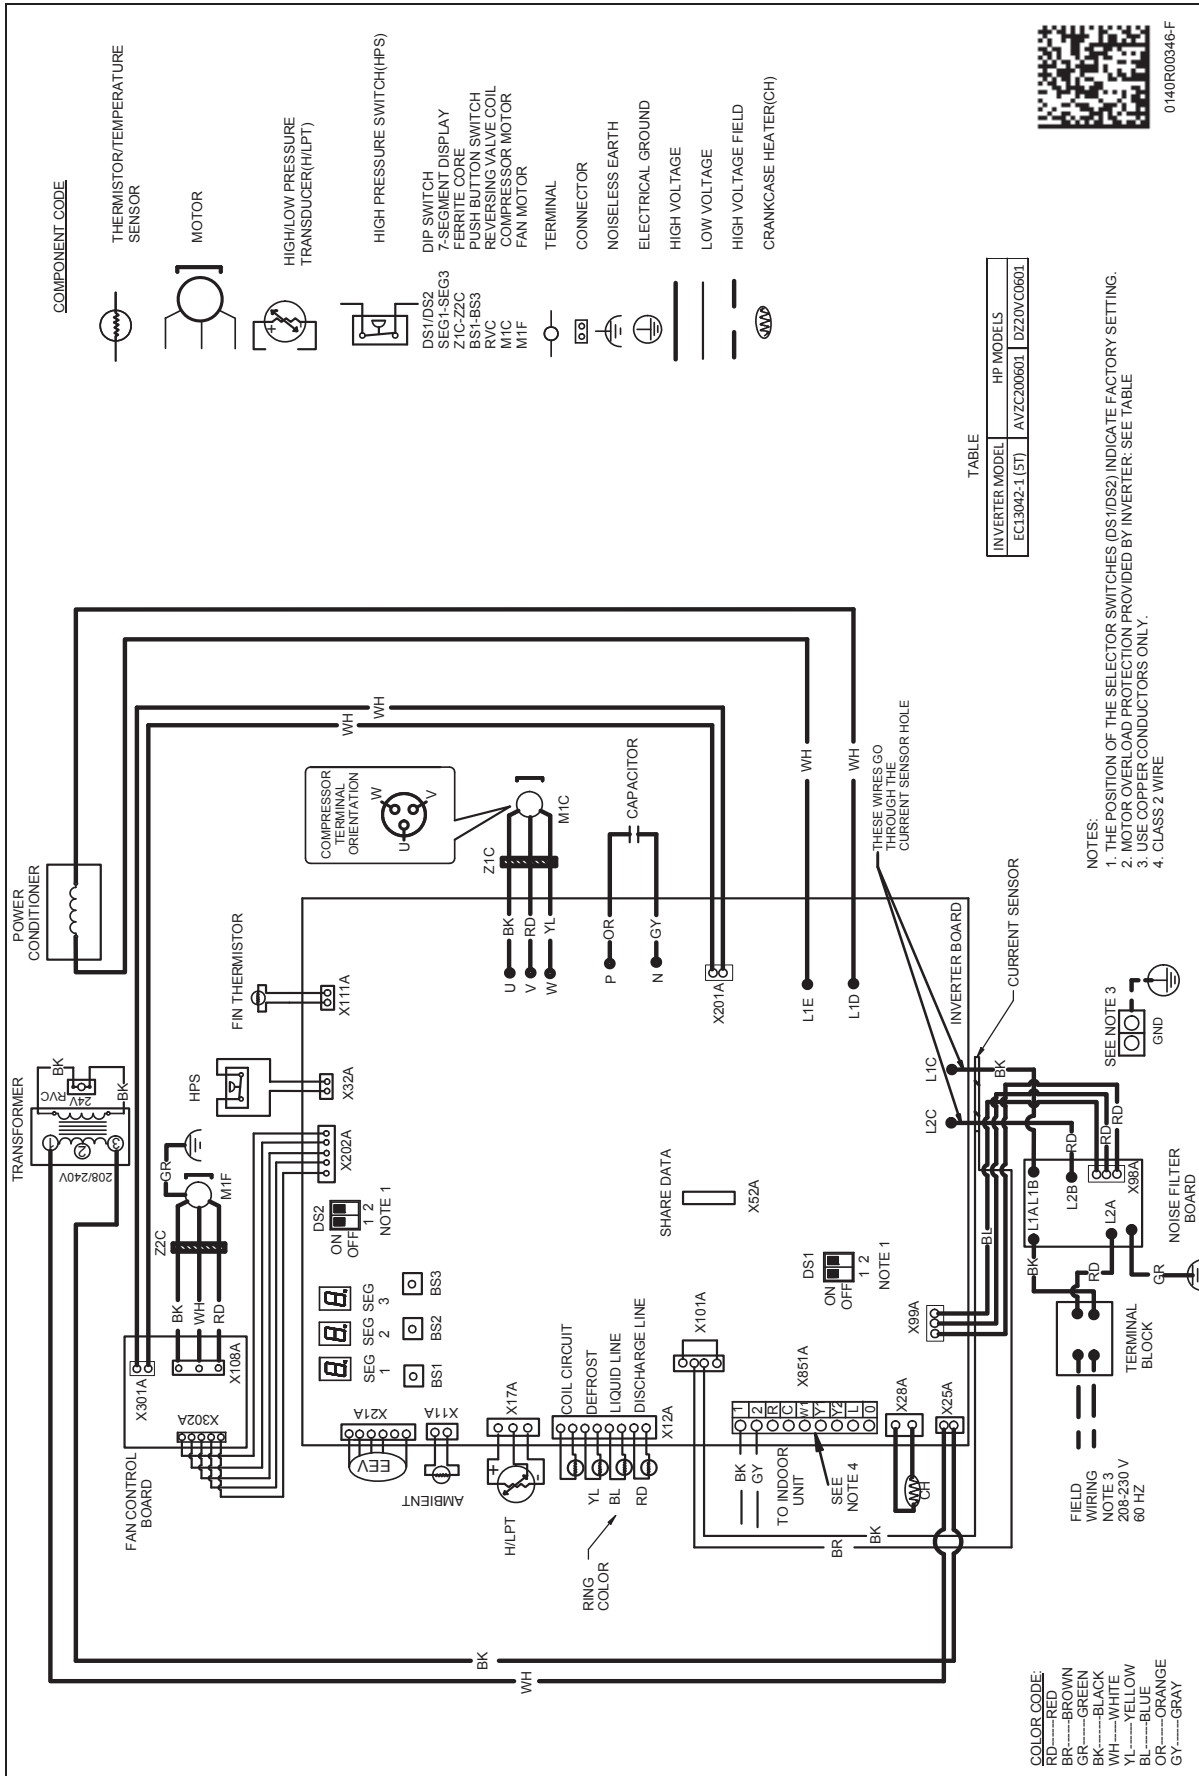

0140R0346-F

MODEL	DESCRIPTION	AVZC20 0241**	AVZC20 0361**	AVZC20 0481**	AVZC20 0601**
ABK-20	Anchor Bracket Kit [◇]	X	X	X	X
TXV-V24	TXV Kit	X			
TXV-V36	TXV Kit		X		
TXV-V48	TXV Kit			X	
TXV-V60	TXV Kit				X

[◇] Contains 20 brackets; four brackets needed to anchor unit to pad

